

Hydraulik - Pneumatik

Steffen Haupt Moritzer Straße 35 01589 Riesa

Telefon: 03525 6801-0 Telefax: 03525 680120 info@haupt-hydraulik.de

Manifold Valves 3- and 5-Valve Differential Pressure H Serie

4190-PM Juni 2002



Vertrieb:

Frau Krauspe Frau Göhler

03525 680110 03525 680111

krauspe@haupt-hydraulik.de goehler@haupt-hydraulik.de

Technischer Außendienst:

Herr Burkhardt

03525 680113 0173 5834091 burkhardt@haupt-hydraulik.de



'H' Series 3 and 5 Valve Differential Pressure Manifolds

Catalog 4190-FM June 2002





Contents

Page 3	Introduction		The star
	intoduction		the second
Page 4/5	Bonnet assembly details and options		
Page 6/7	Manifold key features		III (
Page 8	3 Valve direct mount manifold Pipe to flange style		
Page 9	3 Valve direct mount manifold Base entry and flange style		a the first
Page 10	3 Valve direct mount manifold Extruded body flange style		
Page 11	3 Valve direct mount manifold Compact cast body style		N. Sala
Page 12	3 Valve remote manifold High pressure style		
Page 13	3 Valve manifold 3051 and Miniature style		P Total
Page 14	5 Valve direct mount manifold Pipe to flange style		
Page 15	5 Valve direct mount manifold Custody transfer and oval flange style		Part N
Page 16	5 Valve direct mount manifold 3051 and base entry style		
Page 17	5 Valve direct mount manifold Compact cast body style		1 De
Page 18	5 Valve direct mount manifold Extruded body flange style		
Page 19	5 Valve remote manifold High pressure style		1993
Page 20/21	Manifold bracket mounting		
Page 22	PTFree connect	ti tituti ti tituti ti	P and ful
Page 23	Material matrix		Read
Page 24-27	Manifold options		Function Comments

2

Parker Instrumentation Master Table of Contents

Parker Hannifin Corporation
3-D Drawings

Web Site

Introduction

With years of manifold design and development experience Parker Hannifin are able to offer the most comprehensive range of differential pressure transmitter manifolds available to users for a wide variety of applications and industries. Now consolidated into one catalogue Parker is able to offer a simplified system of selection and choice for all Instrument applications and installations.

In addition to producing manifolds Parker also makes twin and single ferrule compression fittings A-LOK[®] and CPI[™] which are used extensively in the oil, gas, petro-chem, power, processing and many other industries. Combining these as an integral part of manifold and valve bodies users can eliminate pipe threaded connections

reducing leak paths and avoiding the use of thread sealant, a frequent menace to instrument and system performance.

All the valves offered in this catalogue are with PTFree available connections improving system performance, safety factors and simplifying installation and ultimately reducing customer costs.

Continuous product development may from time to time necessitate changes in the details contained in this catalogue. Parker Hannifin reserve the right to make such changes at their discretion and without prior notification.

Instrumentation

Master Table of Contents



All dimensions shown in this catalogue are approximate and subject to change.

FAILURE, IMPROPER SELECTION OR IMPROPER USE OF THE PRODUCTS AND/OR SYSTEMS DESCRIBED HEREIN OR RELATED ITEMS CAN CAUSE DEATH, PERSONAL INJURY AND PROPERTY DAMAGE.

This document and other information from Parker Hannifin Corporation, its subsidiaries and authorized distributors provide product and/or system options for further investigation by users having technical expertise. It is important that you analyze all aspects of your application and review the information concerning the product or system in the current product catalog. Due to the variety of operating conditions and applications for these products or systems, the user, through its own analysis and testing, is solely responsible for making the final selection of the products and systems and assuring that all performance, safety and warning requirements of the application are met.

The products described herein, including without limitation, product features, specifications, designs, availability and pricing, are subject to change by Parker Hannifin Corporation and its subsidiaries at any time without notice.

Offer of Sale The items described in this document are hereby offered for sale by Parker Hannifin Corporation, its subsidiaries or its authorized distributors. This offer and its acceptance are governed by the provisions stated in the "Offer of Sale" located in catalog 4110-U Needle Valves (U Series).

3

Web Site

Search

Parker Hannifin Corporation

3-D Drawings

Standard manifold globe style bonnet design

1. Positive handle retention design featuring broached square engagement positioned by thread locked grub screw.

2. "T" bar

Ergonomically designed for ease of operation. Anti-tamper and lockable devices can be _____ supplied for on site retro-fit.

4. Gland packing adjuster

For maximum packing stability and performance, simple and easily adjustable for gland wear compensation.

6. Valve Bonnet


Standard construction for maximum pressure rating with replaceable bonnet sealing washer arrangement.

8. Thrust Bush

Anti rotational adjustor bush ensures uniform / packing compression, maximising pressure tight sealing and limiting cold flow passages.

10. Bonnet/body washer

Annealed sealing washer to ensure complete atmospheric leakage and allowing on site retrofit of bonnets with 100% re-sealing assurance For safe reliable and repeatable performance



3. Dust Cap

This has a dual purpose, preventing air born debris from contaminating the operating spindle thread and providing colour coded functional identification. Isolate (BLUE) Bleed/test (RED).

5. Gland adjuster lock nut

A secure anti vibration locking mechanism to prevent inadvertent gland adjuster loosening.

7. Anti blowout spindle

Designed for low torque operation with high quality micro mirror stem finish for positive gland sealing.

9. Gland packing (adjustable)

Chevron style dual piece gland packing to provide maximum sealing area contact with minimum gland adjustment.

11. Spindle tip


Self centering, non-rotational tip gives successive positive bubble tight shut off assuring the user of leakage free performance and downstream functional safety.

All metallic standard parts are produced in stainless steel, for alternative materials please refer to page 23. Manifolds produced in other specified materials will be provided with non-wetted parts as standard in stainless steel, this applies to items 1, 2, 4, 5 & 8.

Specification

- Height closed (standard and HP) = 47mm (1.85") Height open (standard and HP) = 50.3mm (2.00")
- Number of turns open/close 3.5.
- Stainless steel construction.
- Maximum standard pressure up to 6,000 psig (414 barg).
- Maximum optional pressure (limited to HP suffix see page 12 & 19) up to 10,000 psig (689 barg).
- Temperature rating -54C to +538C (-65F to +1000F).
- PTFE standard gland packing (Graphoil optional).
- Maximum temperature PTFE 260C (500F).
- Maximum temperature Graphoil 538C (1000F).

Pressure vs temperature



Features

- Standard unit throughout manifold range.
- Operating threads outside washout area.
- Externally adjustable gland.
- Low operating torque.
- Alternative 10,000 psig (689 barg) range available.
- Retro-fit kit for:-Anti-tamper spindle.
 Panel mounting.
 Lockable T bar.
 Handwheel with lockable option.
- Bonnet locking pin to prevent accidental removal fitted as standard.
- Alternative graphite packing for high temperature performance available.
- Alternative self centering tip materials available for gaseous and aggressive fluids.
- Safety back seated spindle prevents stem blowout and provides secondary back up stem seal.
- Packing below threads to prevent lubricant washout.
- All valves 100% factory tested.
- NACE certified wetted parts available.
- Optional cleaned and lubricated suitable for Oxygen service.
- Heat code traceable body and bonnet.



Optional manifold globe style bonnet design

For on-site assembly

The design options below can be simply retrofit to any "H" series standard manifold. Retrofit kit part numbers are listed next to the illustrated option and all parts will be supplied in stainless steel regardless of the parent body material.

For factory fitted assembly


To obtain factory assembled options the manifold part number must be suffixed with the option and function designator. This allows you to select one or both of the bonnets to be fitted with the selected option or, different options to be fitted to either of the bonnets.

Function designator IS – isolate, DR – drain/test, EQ – equalize.

Example HD*5MATDR – manifold with drain/bleed valves (DR) fitted with anti-tamper (AT). Isolate valves will be standard bonnet design.

Example HL*5MHWISTHLDR – manifold with isolate valves fitted with hand-wheel and drain/bleed valves fitted with "T" bar locking mechanism.

Note: Padlocks for lockable handwheels and "T" bars are not supplied (hole size 6mm/0.24").

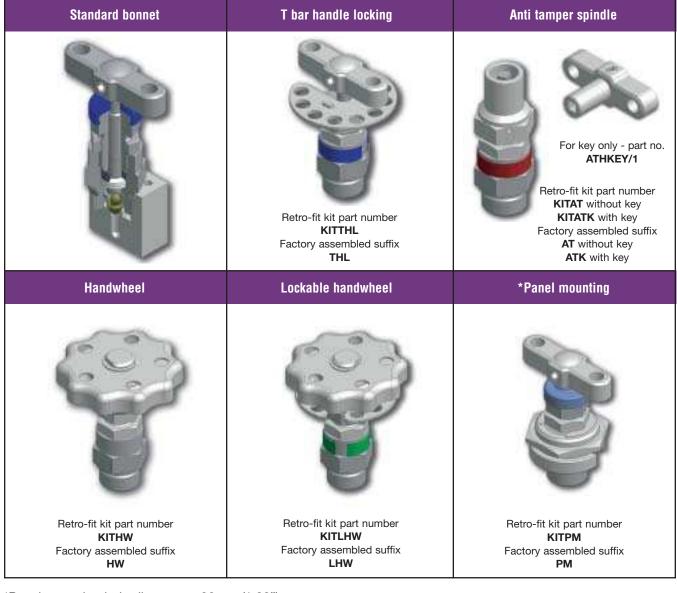

*Panel mounting hole diameter = 26mm (1.02"). Panel thickness = Max 5mm (0.20") Min 2.3mm (0.09").




Three and five valve manifolds for direct or remote mounting

Purpose

Instrument manifolds are a consolidation of single valves into a unitised block and allow engineers the flexibility to perform various tasks and functions without removing the transmitter from its installed position.


Manifold key features (example)

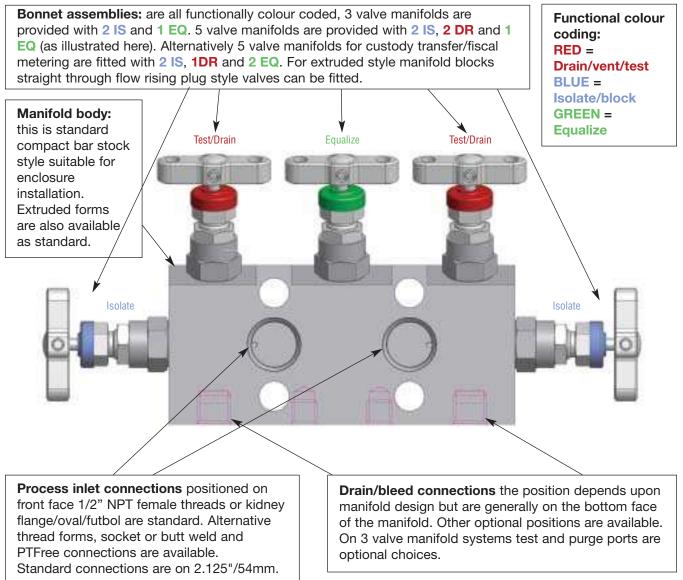

Manifold marking: all manifolds are permanently marked with line diagram showing manifold capability. Example:

316SS Part No: HDS5M PTFE: 260 Deg C (500 F) max. Model: A1......1/2NPT/1/4NPT





All Parker direct mount manifolds are rated up to 6000psig (414 barg). Remote mount 10,000psig (689 barg) are available




Three and five valve manifolds for direct or remote mounting

Instrument side, outlet, flange connections: are standard for direct mount manifolds with machined grooves for PTFE seal rings. Optional DIN sealing groove arrangement is also available. Remote style manifolds are provided as standard with 1/2" NPT female outlet connections (alternative thread forms etc. are available). Flanged outlets are positioned on 54mm/2.125" centres. (56/57mm options are available). Manifolds for 3051 style transmitters are available as standard

Master Table of Contents

Pressure rating:

maximum standard rating 6000psig (414 barg). Remote mount 10,000psig (689 barg) are available

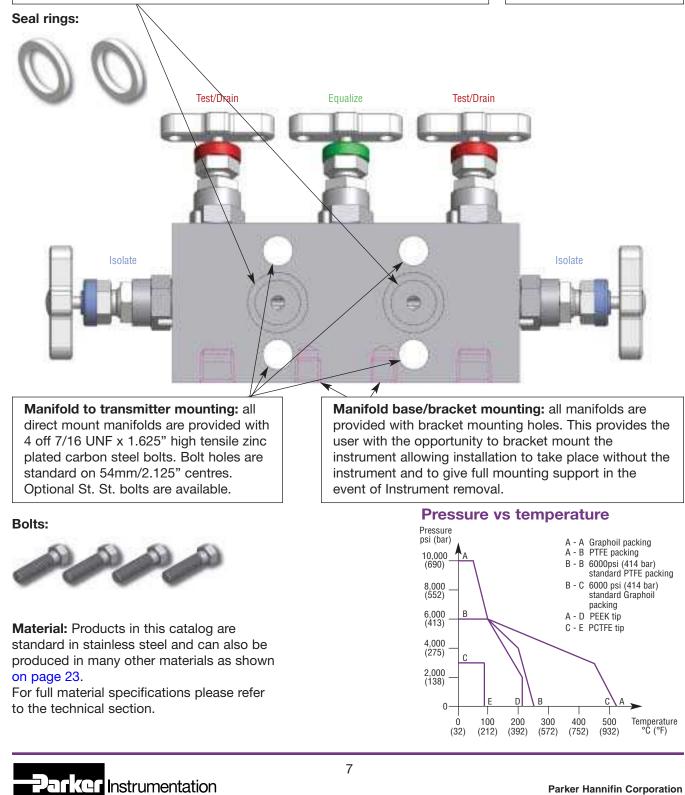


Search

Web Site


3-D Drawings

Compact design for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals. Test ports available as standard on top face (plugs to be ordered separately - not fitted). Purge port options available.

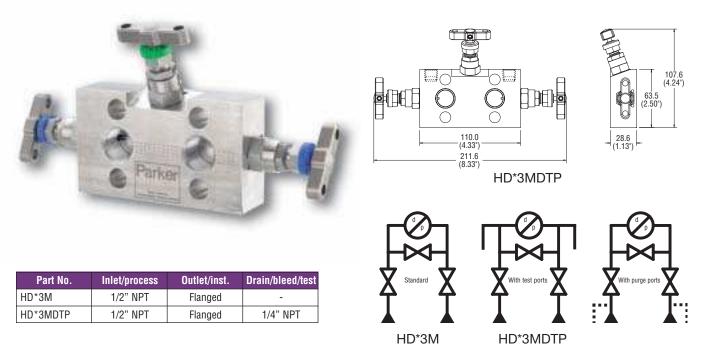


Three valve manifold

Compact design particularly suited for enclosure installation and for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals. Additional test or purge port options are available.

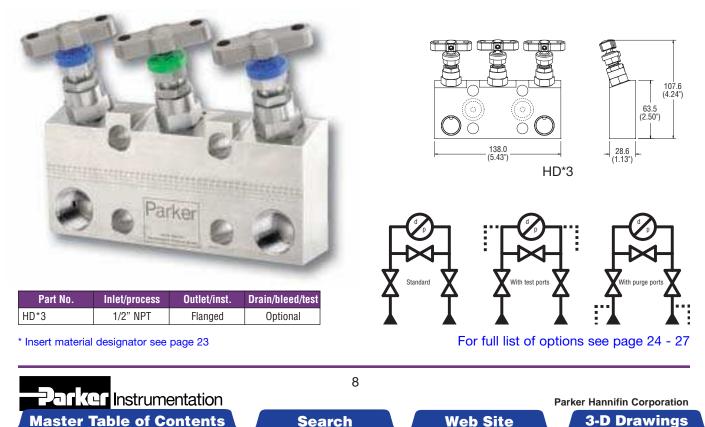


Specifically designed for installation inside enclosures enabling bottom entry connections to be completed outside of the enclosure. Suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals. Additional test or purge port options are available.

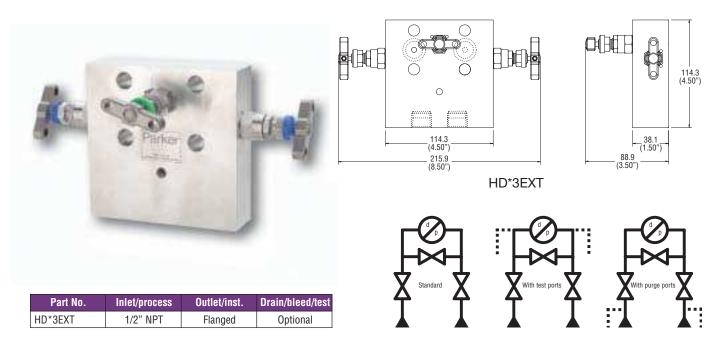


Three valve manifold

Compact design suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres. Process/inlet connections are via standard kidney flange ovals/futbols. Manifold supplied with instrument mounting bolts and PTFE seals. Additional test or purge port options are available.

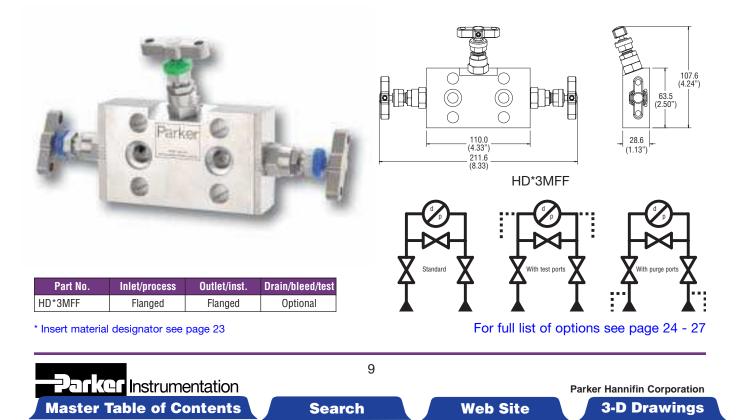


Extruded body design for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals. Additional test or purge port options are available.

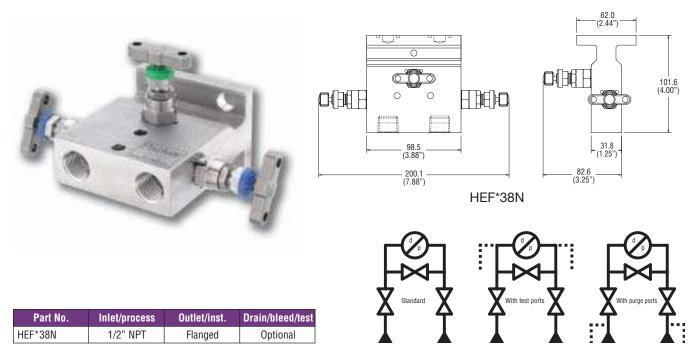


Three valve manifold

Compact design suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres. Process/inlet connections are via standard kidney flange ovals/futbols. Manifold supplied with instrument mounting bolts and PTFE seals. Additional test or purge port options are available. Roddable option available (see CAT4190HV page 6 & 7 for rising plug valve details).

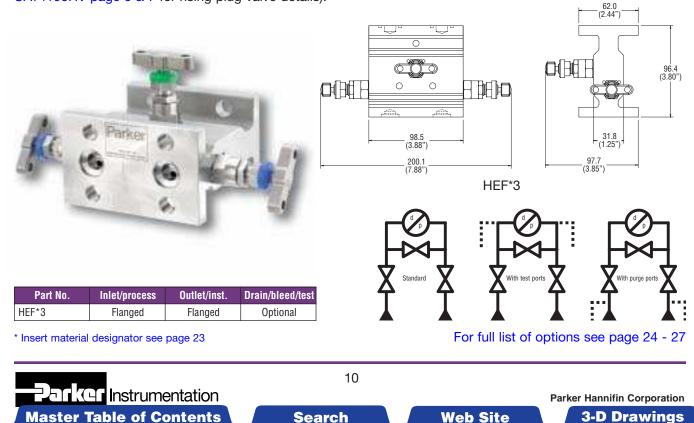


Compact cast body design with optimum positioning of equalize valve for easy access and operation. Manifold suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals. Additional test or purge port options are available.

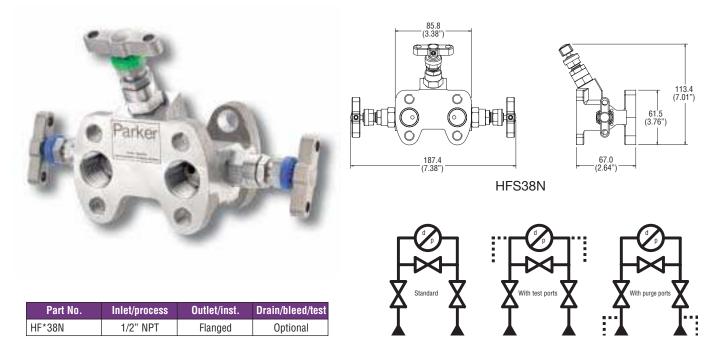


Three valve manifold


Compact cast body design with optimum positioning of equalize valve for easy access and operation. Manifold suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres. Process/inlet connections are via standard kidney flange ovals/futbols. Manifold supplied with instrument mounting bolts and PTFE seals. Additional test or purge port options are available.

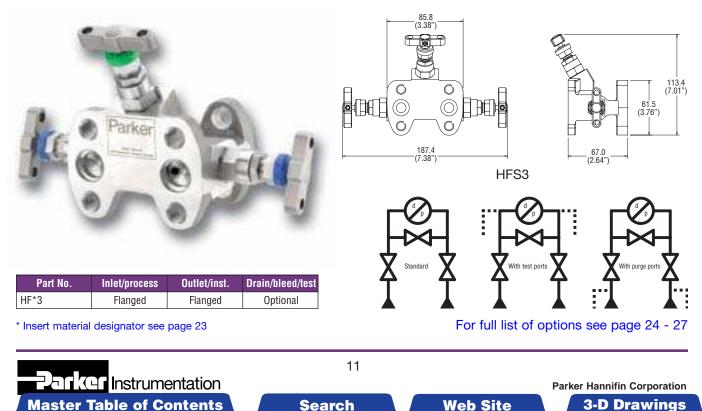

Compact design for remote installation from differential pressure transmitters. Test ports available as standard on top face (plugs to be ordered separately - not fitted). Purge port options available.

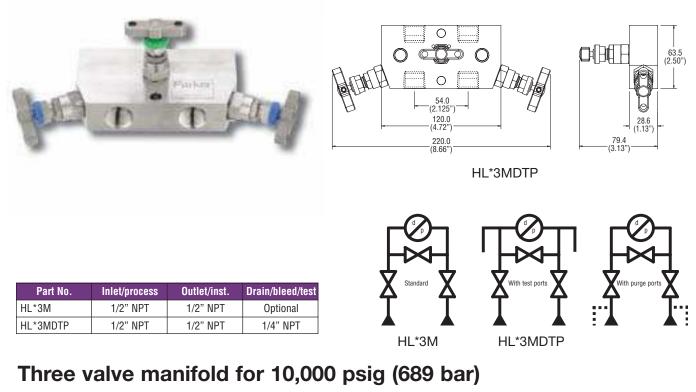


Compact design for remote installation from differential pressure transmitter. Additional test or purge port options are available.

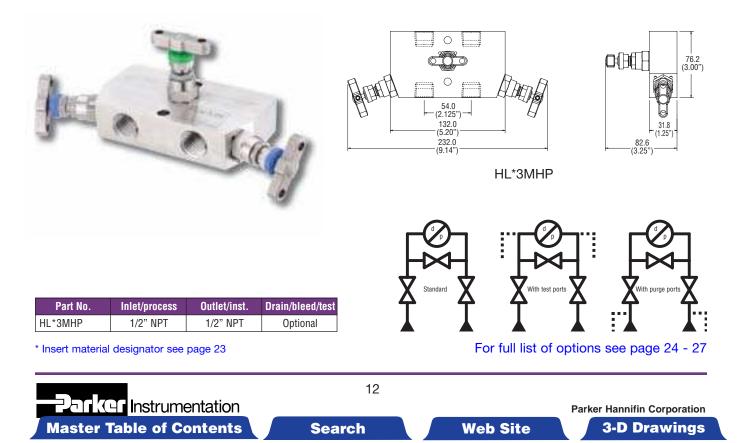

Three valve manifold for model 3051 transmitter


Specifically designed for mounting to the 3051 series of differential pressure transmitters with outlets positioned to avoid the use of the adaptor/convertor flange. Inlet connections are on 54mm/2.125". These manifolds are not supplied with sealing rings, bolts are provided. Additional test or purge port options are available.

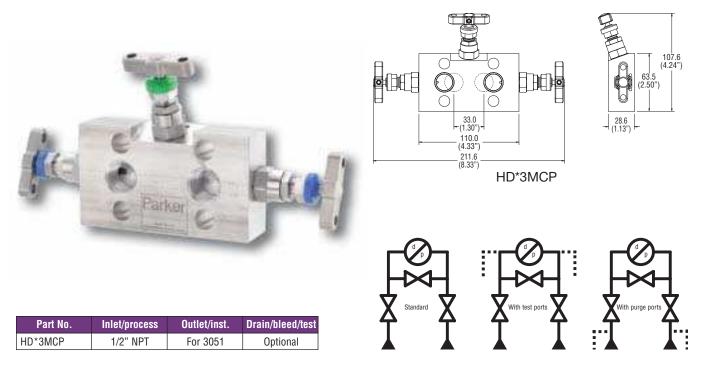

Miniature remote mount manifold

Master Table of Contents

Parker's range of miniature valves and manifolds are ideal for installation inside control panels and other size limited installations where **space** and **weight** are primary considerations.

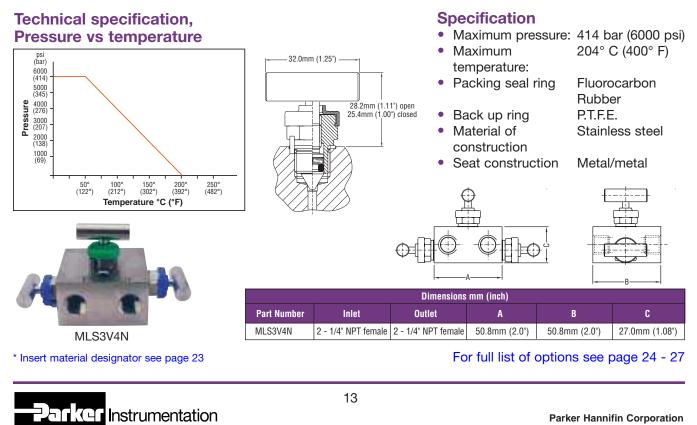


Search

Web Site


3-D Drawings

Compact design for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals.

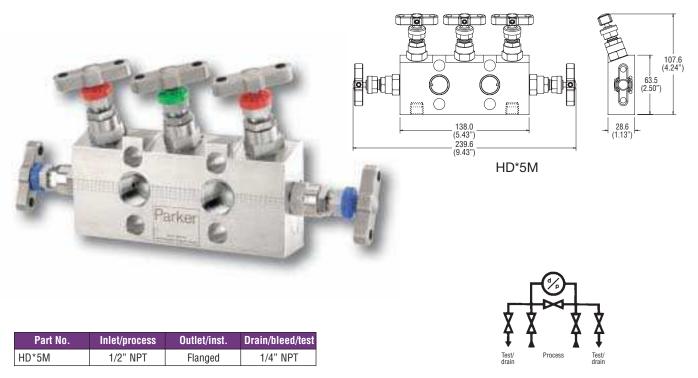


Five valve manifold

Compact design particularly suited for enclosure installation and for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals.

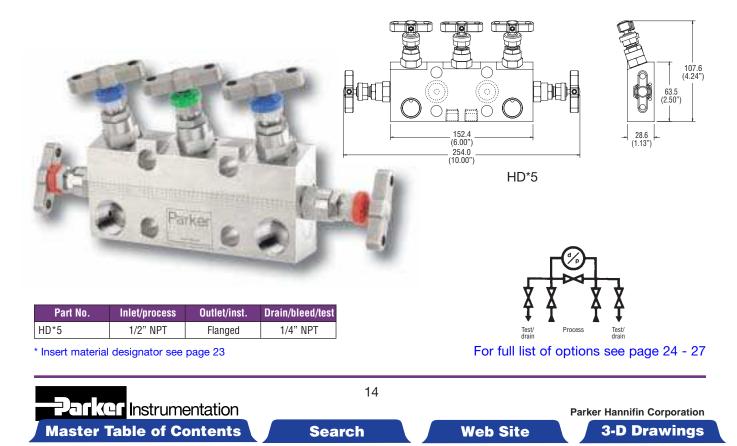


Compact design suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres. Process/inlet connections are via standard kidney flange ovals/futbol. Manifold supplied with instrument mounting bolts and PTFE seals.

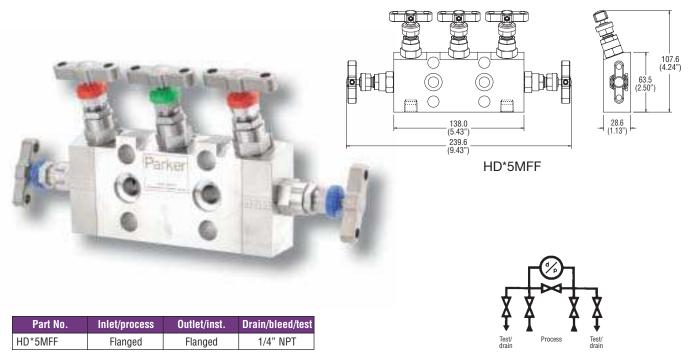


Five valve custody transfer/fiscal metering manifold

Compact design for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals.

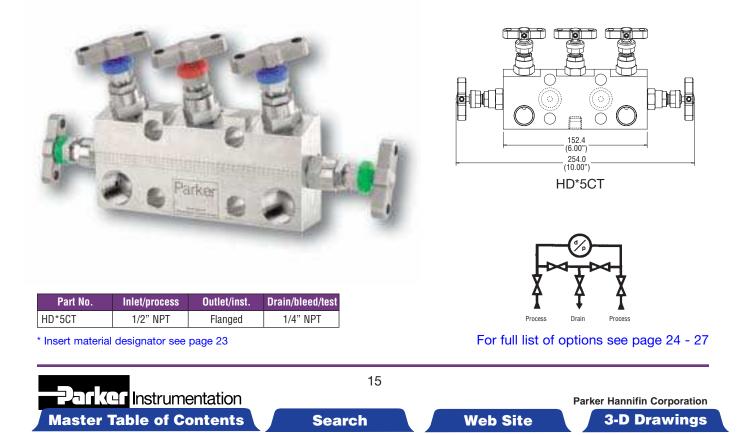


Specifically designed for installation inside enclosures enabling bottom entry connections to be completed outside of the enclosure. Suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres, supplied with instrument mounting bolts and PTFE seals.

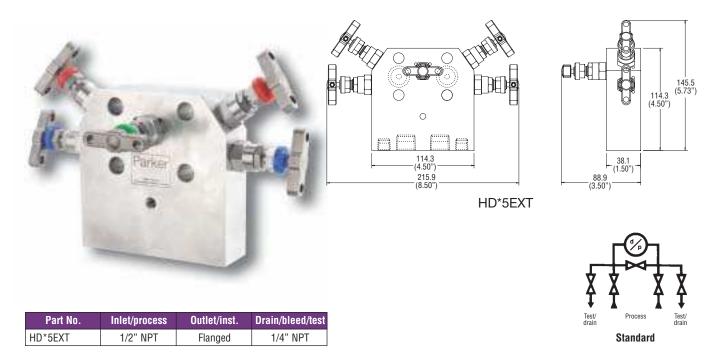

Five valve manifold for model 3051 transmitter

Specifically designed for mounting to the 3051 series of differential pressure transmitters with outlets positioned to avoid the use of the adaptor/convertor flange. Inlet connections are on 54mm/2.125". These manifolds are not supplied with sealing rings, bolts are provided.

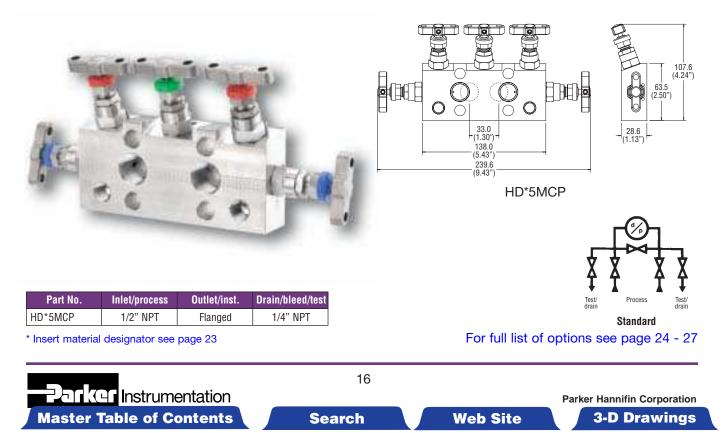



Compact cast body design with optimum positioning of equalize valve for easy access and operation. Manifold suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres. Process/inlet connections are via standard kidney flange ovals/futbol. Manifold supplied with instrument mounting bolts and PTFE seals.




Outlet/inst.

Flanged





HFS5



Five valve manifold

Inlet/process

Flanged


Part No.

HF*5

Compact cast body design suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres. Manifold supplied with instrument mounting bolts and PTFE seals.


Drain/bleed/test

1/4" NPT

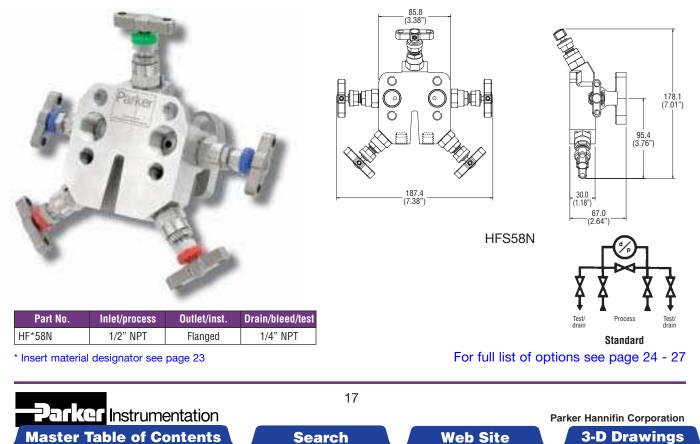


Five valve custody transfer/fiscal metering manifold

Compact design suitable for direct mounting to differential pressure transmitters with 54mm/2.125" mounting centres. Process/inlet connections are via standard kidney flange ovals/futbol. Manifold supplied with instrument mounting bolts and PTFE seals. Optional rising plug valve with 6.4mm (1/4") straight through flow pattern for isolating position available (see CAT 4190HV page 6 & 7 for full specification details).

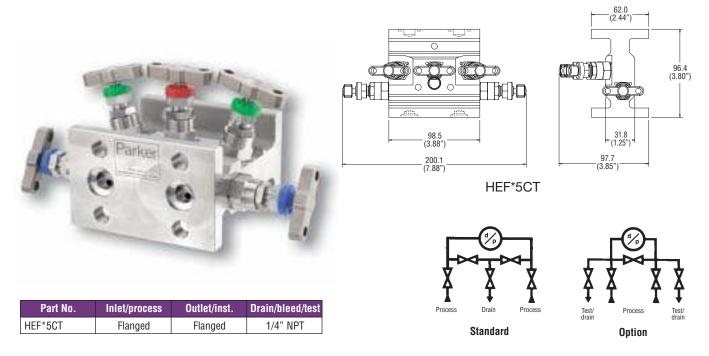


Five valve custody transfer/fiscal metering manifold

Compact design for direct mounting to differential pressure transmitters with 54mm/2.125" centres, supplied with instrument mounting bolts and PTFE seals. Optional rising plug valve with 6.4mm (1/4") straight through flow pattern for isolating position available (see CAT 4190HV page 6 & 7 for full specification details).

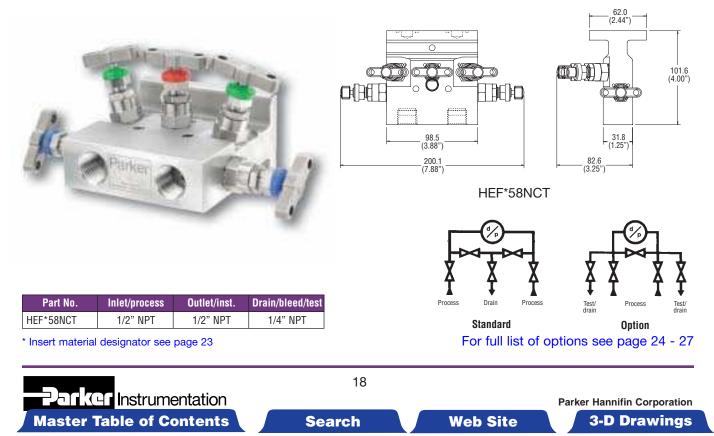


Compact design manifold for remote installation from differential pressure transmitters. Optional custody transfer/fiscal metering available.

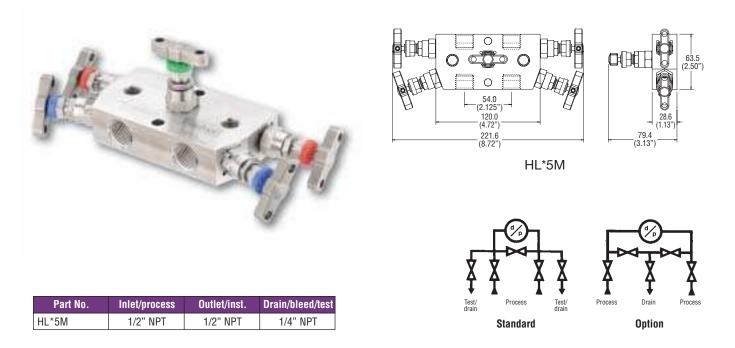

Five valve manifold for 10,000 psig (689 barg)

Compact design manifold for remote installation from differential pressure transmitters. Standard inlet, outlet and test/bleed connections in NPT.

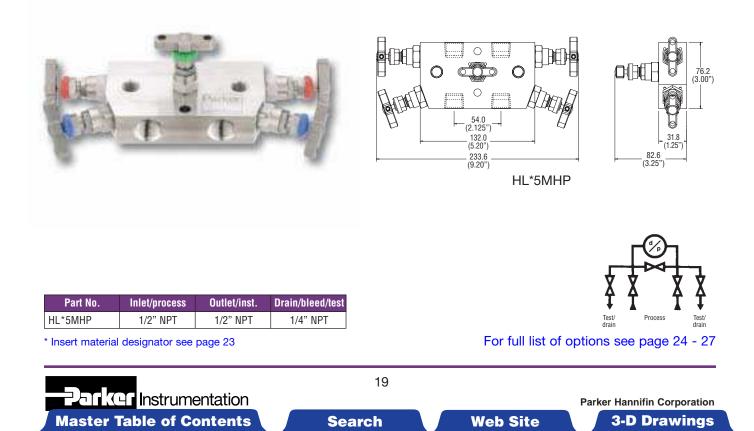

Manifold bracket support

Purpose


It is essential to fully support impulse/pressure measurement tubing lines, manifolds and instruments. All Parker manifolds are designed to accommodate bracket mounting and support, a full range of brackets with additional U bolts are available.

Brackets are designed for panel and wall mounting and give full clearance for ease of handle operation. They are also suitable for vertical and horizontal positioning on 2" pipe-stand.


Standard brackets are produced from 4mm thick carbon steel plate to provide maximum rigidity and support. For full corrosion protection the brackets are shot blasted and zinc sprayed. Alternative bracket material is available upon request.

Part No. BKT5CS

Sutable for:-HD*5 HD*5CT



Simple to install bracket on horizontal or vertical 2" standpipe. Designed for horizontal or vertical mounting of manifold giving total installation flexibility.

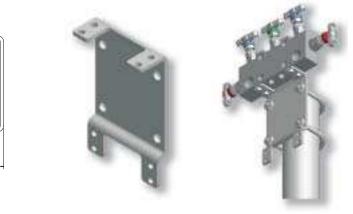


For 'U' bolts suffix part no. with B Example BKT5CSB

For manifold/bracket bolts add 'bolt set' suffix from matrix. Example: Bracket, 'U' bolts and manifold/bracket bolts BKT5CSB6 (suitable for HD*5).

Part No. BKT2CS

Sutable for the above and:-HL*3M HL*3MHP HL*3MDTP HL*5M HL*5HP Universal manifold mounting bracket suitable for all remote mount manifolds. This bracket allows 90 degree positioning enabling total installation flexibility and prevents handle obstruction. Can be wall, standpipe or base mounted.

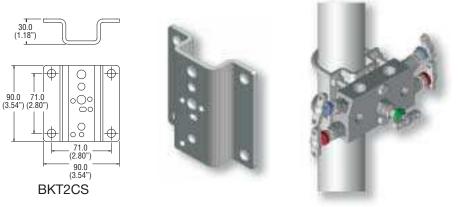

For 'U' bolts suffix part no. with A Example BKT2CSA

For manifold/bracket bolts add 'bolt set' suffix from matrix. Example: Bracket, 'U' bolts and manifold/bracket bolts BKT2CSA5 (suitable for HL*3M).




Manifold bracket support

Part No. BKT3CS


Sutable for:-HD*3M HD*3MDTP HD*3 HD*3MFF HD*3MCP HD*5M HD*5 HD*5MFF HD*5MCP For 'U' bolts suffix

part no. with B

Example BKT3CSB




Universal manifold mounting bracket suitable for direct mount manifolds. This bracket design enables horizontal or vertical instrument positioning. Suitable for 2" standpipe.



For manifold/bracket bolts add 'bolt set' suffix from matrix. Example: Bracket, 'U' bolts and manifold/bracket bolts BKT3CSB2 (suitable for HD*2HLH).

Part No. BKT4CS

Sutable for:-HEF*38N HEF*3 HEF*58NCT HEF*5CT For 'U' bolts suffix part no. with B Example BKT4CSB



10.0 (0.39"

For extruded style manifold blocks providing full base support for horizontal or vertical fixing to 2" standpipe.



For manifold/bracket bolts add 'bolt set' suffix from matrix. Example: Bracket, 'U' bolts and manifold/bracket bolts BKT4CSB4 (suitable for HEF*2LH).

'U' Bolt with nuts and washers for 2" NB standpipe

Part No. UBACS



Manifold/bracket bolts c/w nuts and washers

Manifold Part No.	Bolting Set	Part No.	Suffix
HL*3M	M8 x 45 Bolt + Nuts	BS5	5
HL*3MDTP	M8 x 45 Bolt + Nuts	BS5	5
HL*3MHP	M8 x 45 Bolt + Nuts	BS5	5
HL*5M	M8 x 45 Bolt + Nuts	BS5	5
HL*5MCT	M8 x 45 Bolt + Nuts	BS5	5
HL*5MHP	M8 x 45 Bolt + Nuts	BS5	5
HD*3M	M10 x 14 Bolt	BS2	2
HD*3MDTP	M10 x 14 Bolt	BS2	2
HD*3MFF	M10 x 14 Bolt	BS2	2
HD*3MCP	M10 x 14 Bolt	BS2	2
HD*3	M10 x 14 Bolt	BS2	2
HD*5M	M10 x 14 Bolt	BS2	2
HD*5MFF	M10 x 14 Bolt	BS2	2
HD*5MCP	M10 x 14 Bolt	BS2	2
HD*5CT	M6 x 14 Bolt	BS6	6
HD*5	M6 x 14 Bolt	BS6	6
HEF*38N	M6 x 45 Bolt + Nuts	BS4	4
HEF*3	M6 x 45 Bolt + Nuts	BS4	4
HEFS58NCT	M6 x 45 Bolt + Nuts	BS4	4
HEFS5CT	M6 x 45 Bolt + Nuts	BS4	4

All nut and bolt sets are standard in Carbon Steel

Web Site



21 **Search**

Parker Hannifin Corporation
3-D Drawings

PTFree connect[™]

Manifold connections

Many users continually desire the elimination of taper threads and their associated sealant.


The PTFree connect system enables users to assemble tube lines to any of the manifold ports without the need for PTFE tape or other liquid sealant.

The PTFree connection can be applied to any of the manifold featured in this catalogue. These will be factory fitted, pin locked and pressure tested.

PTFree connect enables angled tube connections to be swivelled until the optimum tube alignment position has been achieved. Assembly to the tube connector is achieved by tightening the standpipe nut one-quarter turn from the finger tight position.

Manifolds can also be supplied with male connectors using the same thread form as the PTFree connect. They can be provided factory fitted, pin locked and tested before they leave our manufacturing plant.

Some size restrictions may be necessary due to the close proximity of some connections and the across flat hexagon dimensions, as a guide PTFree connect for inlet and outlet can be up to 1/2" or 12mm o/d., drain/bleed connections should be restricted to 1/4" or 6mm. For PTFree male connectors inlet and outlet should be restricted to 3/8" or 10mm and 1/4" or 6mm o/d for drain/bleed.

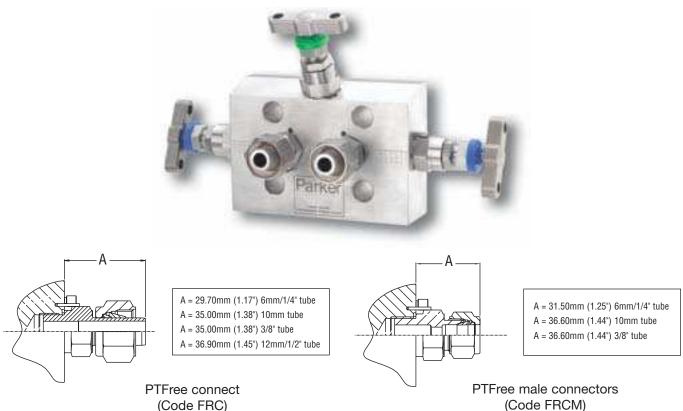

Part Number Construction Examples

	Inlet, Outlet, Drain/vent/test, tube size/thread size & form											
Manifold Part No. + option	Connection Style FRC or FRCM	A-LOK(L) or CPI(B) L or B	Metric or inch tube M or I	Inlet (E) + size	Outlet (X) + size	Drain/vent/test						
HDS5M	FRC	L	М	E12	Flanged	D6						
Part No. HDS5MFRCLME12D6 = 5 valve direct mount manifold with A-LOK PTFree connect™ Inlet - 12mm o.d., Outlet Flanged, Drain/test - 6mm. Stainless steel construction												
HLS3M FRC B I E6 X6 -												
Part No. HLS3MFRCBIE6X6 = 3 valve remote manifold with CPI PTFree connect™ Inlet - 3/8" o.d., Outlet 3/8 o.d. Stainless steel construction												
			22									

Barker Instrumentation Master Table of Contents



Parker Hannifin Corporation **3-D Drawings**

Web Site

'H' series 3 and 5 valve manifolds

Material option		Manifold types								
For full material specification technical section	1 SEE	HD*3M	HL*3M	HEF*38N	HF*38N	ML*3V4N				
		HD*3	HD*3MCP	HEF*3	HF*3					
Material	*Insert code for selected material in part number	HD*3EXT	HD*3MFF							
Stainless steel Std	S	1	1	1	CAST	1				
Monel	М	1	1			1				
Duplex	D1	1	1			1				
Super Duplex	D2	1	1			1				
Hasteloy	HC	1	1			 ✓ 				
Carbon Steel	С	1	1	1						
6Mo	6M0	 ✓ 	1			✓				
Titanium	Т	 ✓ 	1			✓				
Incoloy 825	825	 ✓ 	1			✓				
Inconel 625	625		1			✓				

All non-wetted parts ie those not in contact with the process medium will be supplied in stainless steel.

				Manifold types	5	
		HD*5	HD*5CT	HF*58N	HEF*58NCT	HD*5MFF
		HD*5M	HL*5	HF*5	HEF*5CT	HD*5MCP
Material	*Insert code for selected material in part number	HD*5EXT	HL*5M			
Stainless steel Std	S	1	1	CAST	✓	1
Monel	М	1	1			✓
Duplex	D1	1	1			1
Super Duplex	D2	1	1			1
Hasteloy	HC	1	1			1
Carbon Steel	С	 ✓ 	1		✓ <i>✓</i>	\checkmark
6Mo	6M0	1	1			1
Titanium	Т	1	\checkmark			1
Incoloy 825	825	1	✓			1
Inconel 625	625	1	1			1

All non-wetted parts ie those not in contact with the process medium will be supplied in stainless steel.



Options for three valve manifolds

				s.				
				Page		8	8	9
						-	1.0.0	P. M. P
Suffix adding sequence	Function	Read	Option Detail		Part no. suffix	HD*3M+DTP	HD*3	HD*3EXT
1	Gland packing		Graphoil		3	1	 Image: A second s	\checkmark
2	Seating		PCTFE tip		9	\checkmark	\checkmark	
			PEEK tip		PK	\checkmark	\checkmark	\checkmark
		Note 1	Roddable/rising plug, PTFE packed		RP			
			Stellite Tip		ST	\checkmark	\checkmark	\checkmark
3	Optional connections	Note 2	Purge ports 1/4 NPT		UPP*	\checkmark	\checkmark	 Image: A set of the set of the
		Note 2	Test ports 1/4 NPT		DTP*	\checkmark	\checkmark	 Image: A set of the set of the
4	Blank plugs		Hexagon plugs 1/4 NPT (loose in b	ox)	Р	\checkmark	\checkmark	\checkmark
5	Connection	Note 3	Socket weld (* insert pipe size)		SW*NB	 ✓ 	\checkmark	\checkmark
			Butt weld (* insert pipe size)		BW*NB	 ✓ 	\checkmark	\checkmark
			BSPT (* insert thread size e.g. 8K :		*K	 ✓ 	\checkmark	\checkmark
		Note 4	BSPP (* insert thread size e.g. 8R	= 1/2")	*R	1	\checkmark	\checkmark
			Inverted connections A-LOK/CPI		*A/*Z			
			PTFree connect (see page 22)			 ✓ 	\checkmark	\checkmark
		Note 5	DIN 19213 instrument seal groove	S	DIN**	1	\checkmark	\checkmark
	Operating mechanism		Lockable 'T' Bar		THL	1	\checkmark	\checkmark
	(see page 5 for		Anti tamper spindle		AT	 ✓ 	\checkmark	\checkmark
	functional definition)		Anti tamper spindle + key		ATK	 ✓ 	\checkmark	\checkmark
			Handwheel	HW	 ✓ 	\checkmark	\checkmark	
			Lockable handwheel		LHW	 ✓ 	\checkmark	\checkmark
7	Mounting	Note 6	Assembled to bracket		BRK	 ✓ 	\checkmark	 Image: A second s
			56mm centres		56	 ✓ 	\checkmark	\checkmark
			57mm centres	57	 ✓ 	\checkmark	\checkmark	
			Stainless steel mounting bolts 7/16 M10 x 1.5 C.S. mounting bolts	SSB	 ✓ 	\checkmark	\checkmark	
				CSB10	 ✓ 	\checkmark	\checkmark	
			M10 x 1.5 stainless steel mounting	SSB10	 ✓ 	1	\checkmark	
8	Condition		NACE (latest issue)		NACE	 Image: A start of the start of	 Image: A start of the start of	
			Cleaned and lubricated for oxygen	use	OXY	 Image: A start of the start of	 Image: A start of the start of	
			Firesafe design		FS	 Image: A start of the start of	 Image: A start of the start of	
		Note 7	Heat code trace certificates		HCT	 Image: A start of the start of	 Image: A start of the start of	
			Test certificates		TC	 Image: A start of the start of	 Image: A start of the start of	\checkmark
			Air testing		PT	√	\checkmark	\checkmark

Note 1 Seat material RP = standard acetal, RP9 = PTCFE, RPPK = PEEK.

Note 2 *Specify face F = front, T = top, B = base, S = side (check viability of size and position with sales).

Note 3 For tube socket use 1/16" denominations (i.e. 8 = 1/2") and change NB to TB.

For metric tube size use actual metric (mm) dimensions e.g. SW12MMTB.

Note 4 For test/purge connections in BSPP these will, due to sealing face requirements be limited to 1/8" as standard. Note 5 **Insert seal type B1, B2, or B3.

Note 6 Bracket will include 'U' bolts and manifold/bracket bolts.

Note 7 Heat code traceable certificates for body and bonnet.

 24
 Parker Hannifin Corporation

 Master Table of Contents
 Search
 Web Site
 3-D Drawings

'H' series 3 and 5 valve manifolds

\checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 C.S. mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 stainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark MACE (latest issue) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark V \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Cleaned and lubricated for oxygen use \checkmark Heat code trace certificates			N	lanifold	part nos	S.			
\checkmark	9	10	10	11	11	12	13	13	
\checkmark	METERN	1	A	N.S.	N.BA	F. J. uh	+ 24	74 2 44	
/ / / / / PCTFE tip / / / / / PEEK tip / / / / / Roddable/rising plug, PTFE packed / / / / / / Roddable/rising plug, PTFE packed / / / / / / / Purge ports 1/4 NPT / / / / / / / Purge ports 1/4 NPT / / / / / / / Purge ports 1/4 NPT / / / / / / / Hexagon plugs 1/4 NPT (loose in box) / / / / / / Hexagon plugs 1/4 NPT (loose in box) / / / / / / Network float Socket weld (* insert pipe size) / / / / / / Network float Socket weld (* insert thread size e.g. BK = 1/2 / / / / / / Network float Socket weld	HD*3FF	HEF*38N	HEF*3	HF*38N	HF*3	HL*3M+DTP+HP	HD*3CP	MLS3V4N	Option Detail
✓ ✓ ✓ ✓ ✓ PEEK tip ✓ ✓ ✓ ✓ ✓ Roddable/rising plug, PTFE packed ✓ ✓ ✓ ✓ ✓ ✓ Stellite Tip ✓ ✓ ✓ ✓ ✓ ✓ Purge ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ Perce ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ Purge ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert tripe size) ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2	✓								
Image: Second	 Image: A set of the set of the	 Image: A set of the set of the		 Image: A second s					
✓ ✓ ✓ ✓ ✓ ✓ Stellite Tip ✓ ✓ ✓ ✓ ✓ ✓ Purge ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ ✓ Purge ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ Socket weld (* insert pipe size) ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ ✓ Inverted connect (see page 22) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Inverted connect (see page 22) ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Inverted connect (see page 22) ✓ ✓ ✓	\checkmark	\checkmark	 Image: A second s	\checkmark	1	 ✓ 	 ✓ 		
✓ ✓ ✓ ✓ ✓ Purge ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ Test ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Socket weld (* insert pipe size) ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ BSPT (* insert thread size e.g. BK = 1/2 ✓ ✓ ✓ ✓ ✓ ✓ ✓ DIN 19213 instrument seal grooves ✓ ✓ ✓ ✓ ✓ ✓ <t< td=""><td></td><td></td><td> Image: A start of the start of</td><td></td><td></td><td></td><td></td><td></td><td></td></t<>			 Image: A start of the start of						
V V V V V Test ports 1/4 NPT V V V V V Hexagon plugs 1/4 NPT (loose in box) V V V V V Socket weld (* insert pipe size) V V V V Butt weld (* insert pipe size) V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V BSPT (* insert thread size e.g. BK = 1/2 V V V V PTFree connect (see page 22) V V V V V V V V V	 Image: A set of the set of the	\checkmark		 Image: A second s		-			
\checkmark	✓	\checkmark	 ✓ 	\					
Image: Construction of the construc	 Image: A start of the start of	\checkmark		 Image: A second s		1			
Image: constraint of the state is a state in the state is a	\checkmark	\checkmark	\checkmark	\checkmark	1	1			
Image: constraint of the constr		\checkmark		\checkmark		1			
\checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. $8R = 1/2$ \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark PTFree connect (see page 22) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark DIN 19213 instrument seal grooves \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable 'T' Bar \checkmark Anti tamper spindle \checkmark Anti tamper spindle \checkmark Anti tamper spindle \checkmark Anti tamper spindle \checkmark Anti tamper spindle \checkmark Anti tamper spindle \checkmark Anti tamper spindle \checkmark Anti tamper spindle \checkmark \checkmark \checkmark <td></td> <td>\checkmark</td> <td></td> <td>\checkmark</td> <td></td> <td>1</td> <td></td> <td></td> <td></td>		\checkmark		\checkmark		1			
Image: Second construction of the second consecond consecond construction of the second constructi		\checkmark		\checkmark					
\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark PTFree connect (see page 22) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark DIN 19213 instrument seal grooves \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable 'T' Bar \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle + key \checkmark <td></td> <td>\checkmark</td> <td></td> <td> Image: A start of the start of</td> <td></td> <td>1</td> <td>1</td> <td></td> <td></td>		\checkmark		 Image: A start of the start of		1	1		
\checkmark \checkmark \checkmark \checkmark \checkmark DIN 19213 instrument seal grooves \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable 'T' Bar \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle + key \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle + key \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle + key \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Handwheel \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Handwheel \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Sform centres \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Stainless steel mounting bolts 7/16 UNF \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 c.S. mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 stainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark NACE (latest issue) \checkmark		\checkmark	 ✓ 						
\checkmark \land		\checkmark		 Image: A start of the start of		1	1		
\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \land	 Image: A start of the start of			 Image: A start of the start of	-	1			
\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \land	 Image: A start of the start of	\checkmark	 ✓ 	 Image: A start of the start of	-	1			
\checkmark	\checkmark	 Image: A second s	 Image: A second s	 Image: A second s	1	1	1		
\checkmark	 Image: A set of the set of the	 Image: A second s	 Image: A second s	 Image: A second s	1	1	1		
$ \begin{array}{c c c c c c c c c c c c c c c c c c c $	 Image: A set of the set of the	 Image: A second s	 Image: A second s	 Image: A second s		1	1		
\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $56mm$ centres \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $57mm$ centres \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $57mm$ centres \checkmark <	 Image: A set of the set of the	 Image: A second s	 Image: A second s	 Image: A second s		1	1		
\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark 57 mm centres \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Stainless steel mounting bolts 7/16 UNF \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 C.S. mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 tainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 stainless steel mounting bolts \checkmark </td <td> Image: A set of the set of the</td> <td> Image: A second s</td> <td> Image: A second s</td> <td> Image: A second s</td> <td>1</td> <td>1</td> <td>1</td> <td></td> <td></td>	 Image: A set of the set of the	 Image: A second s	 Image: A second s	 Image: A second s	1	1	1		
\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Stainless steel mounting bolts 7/16 UNF \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 C.S. mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 stainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 stainless steel mounting bolts \checkmark <td> Image: A set of the set of the</td> <td> Image: A second s</td> <td> Image: A second s</td> <td> Image: A second s</td> <td>1</td> <td></td> <td>1</td> <td></td> <td></td>	 Image: A set of the set of the	 Image: A second s	 Image: A second s	 Image: A second s	1		1		
$ \begin{array}{c c c c c c c c c c c c c c c c c c c $	 Image: A set of the set of the	 Image: A second s	 Image: A second s	 Image: A second s	1				
$ \begin{array}{c c c c c c c c c c c c c c c c c c c $	\checkmark						1		Stainless steel mounting bolts 7/16 UNF
✓ ✓ ✓ ✓ ✓ ✓ NACE (latest issue) ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Cleaned and lubricated for oxygen use ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Heat code trace certificates	\checkmark	\checkmark	\checkmark	\checkmark	1				
	\checkmark	\checkmark	\checkmark	\checkmark	1				M10 x 1.5 stainless steel mounting bolts
$\begin{tabular}{ c c c c c c } \hline \swarrow & \checkmark & $Firesafe design \\ \hline \checkmark & $Heat code trace certificates \\ \hline \blacksquare & $	\checkmark	\checkmark	\checkmark	\checkmark	1	1	1	 ✓ 	NACE (latest issue)
$\begin{tabular}{ c c c c c c } \hline \swarrow & \checkmark & $Firesafe design \\ \hline \checkmark & $Heat code trace certificates \\ \hline \blacksquare & $	\checkmark	\checkmark	\checkmark	\checkmark	1	1	1	\checkmark	
	\checkmark	\checkmark	\checkmark	\checkmark	1	1	1	\checkmark	Firesafe design
	\checkmark	 Image: A start of the start of	 ✓ 	 Image: A set of the set of the	1	 ✓ 	 ✓ 	 ✓ 	
	\checkmark	\checkmark	 Image: A second s	_			1	 ✓ 	Test certificates
\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Air testing	\checkmark	\checkmark	\checkmark	\checkmark	 Image: A start of the start of	1	 Image: A start of the start of	√	Air testing

Accessories and spares	Description	Part number	Box quantity
	PTFE manifold/instrument seals	HPTFESEAL/10	10
*Insert 9 PCTFE seat	Graphite manifold/instrument seals	HGRAPHSEAL/10	10
*Insert PK PEEK seat	Isolate valve with PTFE gland, metal seat	HBNTS*ISPTFE/3	3
	Drain/bleed valve with PTFE gland, metal seat	HBNTS*DRPTFE/3	3
	Equalize valve with PTFE gland, metal seat	HBNTS*EQPTFE/3	3
	Isolate valve with graphoil gland, metal seat	HBNTSISGRAP/3	3
	Drain/bleed valve with graphoil gland, metal seat	HBNTSDRGRAP/3	3
	Equalize valve with graphoil gland, metal seat	HBNTSEQGRAP/3	3

25

Search

Parker Hannifin Corporation
3-D Drawings

Options for five valve manifolds

Function Read Option Detail Part no. suffix Part no. suffix <th>Op</th> <th>tions for five</th> <th>valve</th> <th>mannoius</th> <th></th> <th></th> <th>Manifol</th> <th>d part no</th> <th>s.</th>	Op	tions for five	valve	mannoius			Manifol	d part no	s.
Function Read Option Detail Part no. Suffix B P 1 Gland packing Graphoil 3 / / / 2 Seating PCTFE tip (not HP) 9 / / / 3 Optional connections Note 1 Roddable/rising plug, PTFE packed RP / / 3 Optional connections Note 2 Purge ports 1/4 NPT UPP* / / 4 Blank plugs Hexagon plugs 1/4 NPT (loose in box) P / / 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB / / 8 BSPT (* insert thread size e.g. BK = 1/2") *K / / / 1 Inverted connections A-LOK/CPI *A/*Z / / / / 6 Operating mechanism Lockable T Bar THL / / / 1 Inverted connections A-LOK/CPI *A/*Z / / / 6					Page		14	14	15
1 Gland packing Graphoil 3 ✓ ✓ 2 Seating PCTFE tip (not HP) 9 ✓ ✓ PEEK tip PK ✓ ✓ ✓ Note 1 Roddable/rising plug, PTFE packed RP ✓ ✓ 3 Optional connections Note 2 Purge ports 1/4 NPT UPP* ✓ ✓ 4 Blank plugs Hexagon plugs 1/4 NPT (loose in box) P ✓ ✓ 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ ✓ 8 Butt weld (* insert pipe size) BW*NB ✓ ✓ Ø 8 BSPT (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ Ø 9 PTFree connect (see page 22) ✓ ✓ ✓ ✓ Ø 9 Ptree connect (see page 22) ✓ ✓ ✓ ✓ Ø 9 Ptree connect (see page 22) ✓ ✓ ✓ ✓ Ø 9 Anti tamper spindle <td< th=""><th></th><th></th><th></th><th></th><th></th><th></th><th>座,</th><th>A CONTRACTOR</th><th></th></td<>							座,	A CONTRACTOR	
2 Seating PCTFE tip (not HP) 9 √ √ Note 1 Roddable/rising plug, PTFE packed RP √ √ 3 Optional connections Note 2 Purge ports 1/4 NPT UPP* √ √ 4 Blank plugs Hexagon plugs 1/4 NPT DTP* √ √ 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB √ √ 6 Deprating mechanism Lockable 'T' Bar THL √ √ √ 6 Operating mechanism Lockable 'T' Bar THL √ √ √ 7 Mounting Note 6 Assembled to bracket BRK √ √ 7 Mounting Note 6 Assembled to bracket BRK √ √ 9 Connections Note 7 Bart weld (* insert pipe size) W*NB √ √ 9 PTFree connect (see page 22) ✓ ✓ √ √ √ 9 Operating mechanism Lockable 'T' Bar THL ✓ √ √ √	Suffix adding sequence	Function	Read	Option Detail			HD*5M	HD*5	HD *5MFF
PEEK tip PK ✓ ✓ Note 1 Roddable/rising plug, PTFE packed RP 3 Optional connections Note 2 Purge ports 1/4 NPT UPP* ✓ ✓ 4 Blank plugs Hexagon plugs 1/4 NPT DTP* ✓ 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ ✓ 6 Butt weld (* insert pipe size) SW*NB ✓ ✓ ✓ 8 Butt weld (* insert pipe size) SW*NB ✓ ✓ ✓ 8 BSPT (* insert thread size e.g. 3R = 1/2") *K ✓ ✓ 9 PSF (* insert thread size e.g. 3R = 1/2") *K ✓ ✓ 9 PTFree connect (see page 22) ✓ ✓ ✓ ✓ 9 PTFree connect (see page 22) ✓ ✓ ✓ ✓ 10 Note 5 DIN 19213 instrument seal grooves DIN** ✓ ✓ 10 Cakable handwheel HW	1	Gland packing				3	1	 Image: A second s	\checkmark
Note 1 Roddable/rising plug, PTFE packed RP 3 Optional connections Note 2 Purge ports 1/4 NPT UPP* ✓ ✓ 4 Blank plugs Hexagon plugs 1/4 NPT DTP* ✓ ✓ 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ ✓ 5 Connection Note 3 Socket weld (* insert pipe size) BW*NB ✓ ✓ 6 Depression Note 4 BSPP (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ 9 Verter donnections A-LOK/CPI *A/*Z ✓ ✓ ✓ 9 PTFree connect (see page 22) ✓ ✓ ✓ ✓ 9 PTFree connect (see page 22) ✓ ✓ ✓ ✓ 10 Ptree spindle AT ✓ ✓ ✓ ✓ 10 Lockable T' Bar THL ✓ ✓ ✓ ✓ 10 Lockable handwheel HW ✓ ✓ ✓ </th <th>2</th> <th>Seating</th> <th></th> <th>PCTFE tip (not HP)</th> <th></th> <th>9</th> <th>1</th> <th>\checkmark</th> <th>\checkmark</th>	2	Seating		PCTFE tip (not HP)		9	1	\checkmark	\checkmark
Stellite Tip ST ✓ ✓ 3 Optional connections Note 2 Purge ports 1/4 NPT UPP* ✓ ✓ 4 Blank plugs Hexagon plugs 1/4 NPT (loose in box) P ✓ ✓ 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ 6 Butt weld (* insert pipe size) BW*NB ✓ ✓ 1 Inverted connections A-LOK/CPI *A ✓ 1 Inverted connections A-LOK/CPI *A/*Z ✓ 1 Inverted connections A-LOK/CPI *A/*Z ✓ 1 Inverted connections A-LOK/CPI *A/*Z ✓ 1 PTFree connect (see page 22) ✓ ✓ ✓ 1 Purger spindle AT ✓ ✓ 1 Inverted connections 4-LOK/CPI *A/*Z ✓ ✓ 1 PTFree connect (see page 22) ✓ ✓ ✓ 1 Vote 5 DIN 19213 instrument seal grooves DIN** ✓ ✓ 1 Lockable T' Bar THL ✓ ✓ ✓ </th <th></th> <th></th> <th></th> <th>PEEK tip</th> <th></th> <th></th> <th>1</th> <th> Image: A start of the start of</th> <th>\checkmark</th>				PEEK tip			1	 Image: A start of the start of	\checkmark
3 Optional connections Note 2 Purge ports 1/4 NPT UPP* ✓ ✓ 4 Blank plugs Hexagon plugs 1/4 NPT (loose in box) P ✓ ✓ 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ ✓ 6 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ ✓ 8 Butt weld (* insert pipe size) SW*NB ✓ ✓ 8 BSPT (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ Note 4 BSPP (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ 10 Note 5 DIN 19213 instrument seal grooves DIN** ✓ ✓ 6 Operating mechanism Lockable 'T Bar THL ✓ ✓ 10 Anti tamper spindle AT ✓ ✓ ✓ 6 Operating mechanism Lockable handwheel HW ✓ ✓ 10 Anti tamper spindle AT ✓ ✓ ✓ </th <th></th> <th></th> <th>Note 1</th> <th></th> <th></th> <th></th> <th></th> <th></th> <th></th>			Note 1						
Image: Second							1	1	\checkmark
4 Blank plugs Hexagon plugs 1/4 NPT (loose in box) P ✓ ✓ 5 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ ✓ 6 Butt weld (* insert pipe size) BW*NB ✓ ✓ ✓ 8 Note 4 BSPT (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ 1 Inverted connections A-LOK/CPI *A/*Z ✓ ✓ ✓ 9 Operating mechanism Lockable 'T' Bar THL ✓ ✓ 6 Operating mechanism Lockable 'T' Bar THL ✓ ✓ 1 Unctional definition) Anti tamper spindle AT ✓ ✓ 7 Mounting Note 6 Assembled to bracket BRK ✓ ✓ 7 Mounting Note 6 Assembled to bracket BRK ✓ ✓ 8 Condition NACE (latest issue) MACE (latest issue) NACE ✓ ✓ 8 Condition NACE (latest issue) NACE ✓ ✓ ✓ 9 Con	3	Optional connections	Note 2				1	1	\checkmark
5 Connection Note 3 Socket weld (* insert pipe size) SW*NB ✓ Butt weld (* insert pipe size) BW*NB ✓ ✓ BSPT (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ Note 4 BSPP (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ Inverted connections A-LOK/CPI *A/*Z ✓ ✓ ✓ PTFree connect (see page 22) ✓ ✓ ✓ ✓ Note 5 DIN 19213 instrument seal grooves DIN** ✓ ✓ G Operating mechanism Lockable 'T' Bar THL ✓ ✓ functional definition) Anti tamper spindle AT ✓ ✓ Handwheel HW ✓ ✓ ✓ ✓ Mounting Note 6 Assembled to bracket BRK ✓ ✓ Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ ✓ Mounting NACE (latest issue) NACE ✓ ✓ G Condition NACE (latest issue) NACE ✓ ✓ Handwheel <			Note 2			DTP*			
Butt weld (* insert pipe size) BW*NB ✓ ✓ BSPT (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ Note 4 BSPP (* insert thread size e.g. 8R = 1/2") *R ✓ ✓ Inverted connections A-LOK/CPI *A/*Z ✓ ✓ ✓ PTFree connect (see page 22) ✓ ✓ ✓ ✓ Note 5 DIN 19213 instrument seal grooves DIN** ✓ ✓ 6 Operating mechanism Lockable 'T' Bar THL ✓ ✓ functional definition) Anti tamper spindle AT ✓ ✓ Handwheel HW ✓ ✓ ✓ Vote 6 Assembled to bracket BRK ✓ ✓ Softm centres 56 ✓ ✓ ✓ ✓ Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ ✓ Stainless steel mounting bolts SSB10 ✓ ✓ ✓ <th>4</th> <th></th> <th></th> <th></th> <th>ox)</th> <th></th> <th>1</th> <th>1</th> <th>\checkmark</th>	4				ox)		1	1	\checkmark
Image: Note 4 BSPT (* insert thread size e.g. 8K = 1/2") *K ✓ ✓ Note 4 BSPP (* insert thread size e.g. 8R = 1/2") *R ✓ ✓ Inverted connections A-LOK/CPI *A/*Z ✓ ✓ ✓ PTFree connect (see page 22) ✓ ✓ ✓ ✓ Note 5 DIN 19213 instrument seal grooves DIN** ✓ ✓ G Operating mechanism Lockable 'T' Bar THL ✓ ✓ functional definition) Anti tamper spindle AT ✓ ✓ Handwheel HW ✓ ✓ ✓ ✓ Lockable handwheel LHW ✓ ✓ ✓ ✓ Mounting Note 6 Assembled to bracket BRK ✓ ✓ Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ ✓ M10 x 1.5 C.S. mounting bolts SSB10 ✓ ✓ ✓ Stainless steel mountin	5	Connection	Note 3				1	1	
Note 4 BSPP (* insert thread size e.g. 8R = 1/2") *R ✓ ✓ Inverted connections A-LOK/CPI *A/*Z ✓							1	1	
Inverted connections A-LOK/CPI *A/*Z Image: connect (see page 22) Image: connect (see page 23) Image: connece (see page 23) Image: conne							1	1	
Image: system of the system			Note 4	BSPP (* insert thread size e.g. 8R	= 1/2")		1	 Image: A set of the set of the	
Note 5 DIN 19213 instrument seal grooves DIN** ✓ ✓ 6 Operating mechanism Lockable 'T' Bar THL ✓ ✓ functional definition) Anti tamper spindle AT ✓ ✓ functional definition) Anti tamper spindle + key ATK ✓ ✓ Handwheel HW ✓ ✓ ✓ ✓ 7 Mounting Note 6 Assembled to bracket BRK ✓ ✓ 7 Mounting Note 6 Assembled to bracket BRK ✓ ✓ 6 Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ ✓ ✓ 8 Condition NACE (latest issue) NACE ✓ ✓ ✓ 6 Cleaned and lubricated for oxygen use OXY ✓ ✓ ✓				Inverted connections A-LOK/CPI		*A/*Z			
6 Operating mechanism Lockable 'T' Bar THL ✓ ✓ (see page 5 for Anti tamper spindle AT ✓ ✓ functional definition) Anti tamper spindle + key ATK ✓ ✓ Handwheel HW ✓ ✓ ✓ 7 Mounting Note 6 Assembled to bracket BRK ✓ ✓ 7 Mounting Note 6 Assembled to bracket BRK ✓ ✓ 9 56mm centres 56 ✓ ✓ ✓ 9 Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ 9 M10 x 1.5 c.S. mounting bolts CSB10 ✓ ✓ 8 Condition NACE (latest issue) NACE ✓ ✓ 9 Cleaned and lubricated for oxygen use OXY ✓ ✓ 9 Cleaned and lubricated for oxygen use OXY ✓ ✓				PTFree connect (see page 22)			1	 Image: A set of the set of the	
(see page 5 for Anti tamper spindle AT ✓ ✓ functional definition) Anti tamper spindle + key ATK ✓ ✓ Handwheel HW ✓ ✓ ✓ Lockable handwheel LHW ✓ ✓ Mounting Note 6 Assembled to bracket BRK ✓ 56mm centres 56 ✓ ✓ 57mm centres 57 ✓ ✓ Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ Condition NACE (latest issue) NACE ✓ ✓ Cleaned and lubricated for oxygen use OXY ✓ ✓			Note 5		DIN**	1	1	 Image: A set of the set of the	
functional definition) Anti tamper spindle + key ATK ✓ ✓ Handwheel HW ✓ ✓ ✓ ✓ Lockable handwheel LHW ✓ ✓ ✓ Mounting Note 6 Assembled to bracket BRK ✓ ✓ 56mm centres 56 ✓ ✓ ✓ 57mm centres 57 ✓ ✓ Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ Condition NACE (latest issue) NACE ✓ ✓ Cleaned and lubricated for oxygen use OXY ✓ ✓ Firesafe design FS ✓ ✓ ✓	6						1	1	 Image: A set of the set of the
Image: Mounting Handwheel HW Image: Mounting 7 Mounting Note 6 Assembled to bracket BRK Image: Mounting 7 Mounting Note 6 Assembled to bracket BRK Image: Mounting 7 Mounting Note 6 Assembled to bracket BRK Image: Mounting 1 56mm centres 56 Image: Mounting Image: Mounting Image: Mounting 1 57mm centres 57 Image: Mounting Image: Mounting Image: Mounting 1 Stainless steel mounting bolts 7/16 UNF SSB Image: Mounting Image: Mounting 1 M10 x 1.5 C.S. mounting bolts CSB10 Image: Mounting Image: Mounting Image: Mounting 1 M10 x 1.5 stainless steel mounting bolts SSB10 Image: Mounting Image: Mounting Image: Mounting 8 Condition NACE (latest issue) NACE Image: Mounting Image: Mounting 1 Cleaned and lubricated for oxygen use OXY Image: Mounting Image: Mounting Image: Mounting 1 Firesafe design FS Imag							1	1	 Image: A set of the set of the
Image: Note of the system Lockable handwheel LHW Image: Note of the system Image: Note of the system Note of the system Assembled to bracket BRK Image: Note of the system Image: Note of the system Note of the system Assembled to bracket BRK Image: Note of the system Image: Note of the system Note of the system Assembled to bracket BRK Image: Note of the system Image: Note of the system Stainless steel mounting bolts 7/16 UNF SSB Image: Note of the system Image: Note of the system Image: Note of the system M10 x 1.5 C.S. mounting bolts CSB10 Image: Image: Note of the system Image: Image: Note of the system Image: Note of the system M10 x 1.5 stainless steel mounting bolts SSB10 Image: Image: Image: Image: Note of the system Image: I		functional definition)				1	1	 Image: A set of the set of the	
Mounting Note 6 Assembled to bracket BRK ✓ ✓ 56mm centres 56 ✓ ✓ 57mm centres 57 ✓ ✓ Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ Condition NACE (latest issue) NACE ✓ ✓ Cleaned and lubricated for oxygen use OXY ✓ ✓						1	1	 Image: A set of the set of the	
56mm centres 56 ✓ ✓ 57mm centres 57 ✓ ✓ Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ Condition NACE (latest issue) NACE ✓ ✓ Cleaned and lubricated for oxygen use OXY ✓ ✓ Firesafe design FS ✓ ✓				Lockable handwheel			1	1	 Image: A set of the set of the
Stainless steel mounting bolts 7/16 UNF SSB ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ Stainless steel mounti	7	Mounting	Note 6				 ✓ 	1	\checkmark
Stainless steel mounting bolts 7/16 UNF SSB ✓ ✓ M10 x 1.5 C.S. mounting bolts CSB10 ✓ ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ ✓ NACE (latest issue) NACE ✓ ✓ Cleaned and lubricated for oxygen use OXY ✓ ✓ Firesafe design FS ✓ ✓							1	1	
M10 x 1.5 C.S. mounting bolts CSB10 ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ M10 x 1.5 stainless steel mounting bolts SSB10 ✓ Condition NACE (latest issue) NACE ✓ Cleaned and lubricated for oxygen use OXY ✓ Firesafe design FS ✓						1	1		
M10 x 1.5 stainless steel mounting bolts SSB10 ✓ Condition NACE (latest issue) NACE ✓ Cleaned and lubricated for oxygen use OXY ✓ Firesafe design FS ✓									\checkmark
8 Condition NACE (latest issue) NACE ✓ Cleaned and lubricated for oxygen use OXY ✓ Firesafe design FS ✓						1	1	\checkmark	
Cleaned and lubricated for oxygen useOXY✓Firesafe designFS✓							1	\checkmark	
Firesafe design FS 🗸 🗸	8	Condition					 ✓ 	1	\checkmark
Firesafe designFS✓Note 7Heat code trace certificatesHCT✓					use		 ✓ 	1	\checkmark
Note 7 Heat code trace certificates HCT ✓ ✓				Firesafe design		 ✓ 	1	\checkmark	
			Note 7				 ✓ 	1	\checkmark
									\checkmark
Air testingPTI				Air testing		PT	√	1	\checkmark

Note 1 Seat material RP = standard acetal, RP9 = PTCFE, RPPK = PEEK.

Note 2 *Specify face F = front, T = top, B = base (check viability of size and position with sales).

Note 3 For tube socket use 1/16" denominations (i.e. 8 = 1/2") and change NB to TB.

For metric tube size use actual metric (mm) dimensions e.g. SW12MMTB.

Note 4 For test/purge connections in BSPP these will, due to sealing face requirements be limited to 1/8" as standard. Note 5 **Insert seal type B1, B2, or B3.

Note 6 Bracket will include 'U' bolts and manifold/bracket bolts.

Note 7 Heat code traceable certificates for body and bonnet.

 26
 Parker Hannifin Corporation

 Master Table of Contents
 Search
 Web Site
 3-D Drawings

'H' series 3 and 5 valve manifolds

| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. $8R = 1/2")$ \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark PTFree connect (see page 22) \checkmark

 |
 | | N | lanifold | part nos | S. | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

--
--
--
--
--
--
--
--
--
--
--|--|---|---|--|-----------------------|-----------------------|--------------
--|--|--|--|-----------------------|---
--|---|---|---|--------------|--|---|--------------|--------------|--------------|--|---|--|--------------|--------------|----------------------------------|---|--------------|--------------|--------------|--|--------------|--|--------------|--------------|--------------------------------|---
---|---|---|--|---|--|---|---|--|---|---|---|---|--|---|--|---|-----------------------|--
--|--|--|--|---|---|--|---|--|--------------------------------|---|---
---|---|--|---|--|---|-----------------------|------------------------------|---|---
---|---|---|---|--|--|--|--|---|--------------|---|---
---|---|---|---|--|------------------|---|--------------|---|---
--|---|---|---|---|---------------------
--
--|--------------|---|---|--|---|---|---|--|--|---|--------------
---	---	--	---	---	---	--	--	---	--------------
---	---	--	---	---	---	--	----------------------	---	--------------
---	---	--	--	--	--	---	--	--	--
V V V V V V Graphoil V V V V V V PCTFE tip V V V V V V PCTFE tip V V V V V PEEK tip V V V V V Purge ports 1/4 NPT V V V V V Purge ports 1/4 NPT V V V V V Purge ports 1/4 NPT V V V V V Purge ports 1/4 NPT V V V V V Perge ports 1/4 NPT									

 | 15
 | 16 | 16 | 17 | 17 | 18 | 18 | 19
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| V V V V V V Graphoil V V V V V V PCTFE tip V V V V V V PCTFE tip V V V V V PEEK tip V V V V V Purge ports 1/4 NPT V V V V V Purge ports 1/4 NPT V V V V V Purge ports 1/4 NPT V V V V V Purge ports 1/4 NPT V V V V V Perge ports 1/4 NPT

 | - Carlor
 | 1-3 | 間 | 臺 | 臺 | | | K-S-SA
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| / / / / / / PCTFE tip / / / / / / PEEK tip / / / / / Roddable/rising plug, PTFE packed / / / / / / Roddable/rising plug, PTFE packed // / / / / / Purge ports 1/4 NPT // / / / / / Purge ports 1/4 NPT // / / / / / Purge ports 1/4 NPT // / / / / / Purge ports 1/4 NPT // / / / / / Purge ports 1/4 NPT // / / / / / Purge ports 1/4 NPT // / / / / / Purge ports 1/4 NPT // / / / / / Socket weld (* insert pipe size) // / / / / / BSPT (* insert thread size e.

 | HD*5CT | HD*5EXT | HD*5MCP | HF*5 | HF*58N | HEF*5CT | HEF*8NCT | HL*5M+HP
 | Option Detail | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| ✓ ✓ ✓ ✓ ✓ ✓ PEEK tip ✓ ✓ ✓ ✓ ✓ Roddable/rising plug, PTFE packed ✓ ✓ ✓ ✓ ✓ ✓ ✓ Stellite Tip ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Stellite Tip ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Y Y Y ✓ ✓ ✓ ✓ ✓ ✓ ✓ Y

 | | | | | | | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Image: Second

 | \checkmark
 | ✓ | \checkmark | \checkmark | ✓ | ✓ | 1 | ✓ | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| ✓ ✓ ✓ ✓ ✓ ✓ ✓ Stellite Tip ✓ ✓ ✓ ✓ ✓ ✓ ✓ Purge ports 1/4 NPT ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Hexagon plugs 1/4 NPT (loose in box) ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Socket weld (* insert pipe size) ✓ ✓ ✓ ✓ ✓ ✓ ✓ BSPP (* insert thread size e.g. BR = 1/2") ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ Inverted connections A-LOK/CPI ✓ ✓ ✓ ✓ ✓ ✓

 | \checkmark | ✓ | \checkmark | \checkmark | ✓ | ✓ | 1 | ✓
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Purge ports 1/4 NPT \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Test ports 1/4 NPT \checkmark Hexagon plugs 1/4 NPT (loose in box) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Hexagon plugs 1/4 NPT (loose in box) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Hexagon plugs 1/4 NPT (loose in box) \checkmark Socket weld (* insert pipe size) \checkmark Butt weld (* insert pipe size) \checkmark <t< td=""><td></td><td></td><td></td><td></td><td></td><td>1</td><td>1</td><td></td><td></td></t<>

 |
 | | | | | 1 | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark Test ports 1/4 NPT \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Hexagon plugs 1/4 NPT (loose in box) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Hexagon plugs 1/4 NPT (loose in box) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Socket weld (* insert pipe size) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BK = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \blacksquare \blacksquare \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \blacksquare \blacksquare \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \blacksquare \checkmark \checkmark \checkmark \checkmark \checkmark \blacksquare \blacksquare \blacksquare \checkmark \checkmark \checkmark <td< td=""><td> Image: A set of the set of the</td><td></td><td></td><td></td><td></td><td>1</td><td>1</td><td> ✓ </td><td></td></td<>

 | Image: A set of the set of the |
 | | | | 1 | 1 | ✓ | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | |
 | | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \lor \checkmark \lor \lor \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \lor \lor \lor \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \lor \lor \lor \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \lor \lor \lor \lor \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \lor <

 | Image: A start of the start of | ✓
 | \checkmark | Image: A second s | 1 | 1 | 1 | ✓ | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Socket weld (* insert pipe size) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Butt weld (* insert pipe size) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BK = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BK = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark <tr <="" td=""><td> Image: A set of the set of the</td><td></td><td></td><td></td><td></td><td>1</td><td>1</td><td></td><td></td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Butt weld (* insert pipe size)$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$BSPT (* insert thread size e.g. BK = 1/2")$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$BSPP (* insert thread size e.g. BR = 1/2")$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Inverted connections A-LOK/CPI$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Inverted connections A-LOK/CPI\checkmark<</td><td> Image: A second s</td><td> ✓ </td><td> Image: A start of the start of</td><td> Image: A second s</td><td>1</td><td>1</td><td>1</td><td>\checkmark</td><td></td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$BSPT (* insert thread size e.g. BK = 1/2")$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$BSPP (* insert thread size e.g. 8R = 1/2")$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Inverted connections A-LOK/CPI$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Inverted connections A-LOK/CPI\checkmark</td><td>\checkmark</td><td>\checkmark</td><td>\checkmark</td><td></td><td>1</td><td></td><td>\checkmark</td><td>\checkmark</td><td>Socket weld (* insert pipe size)</td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$BSPP (* insert thread size e.g. $8R = 1/2")$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Inverted connections A-LOK/CPI$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$PTFree connect (see page 22)\checkmark<t< td=""><td>\checkmark</td><td>\checkmark</td><td>\checkmark</td><td></td><td>\checkmark</td><td></td><td>\checkmark</td><td>\checkmark</td><td>Butt weld (* insert pipe size)</td></t<></td></tr> <tr><td>Image: Second constraint of the second constrant of the second constraint of the second co</td><td> Image: A set of the set of the</td><td><</td><td><</td><td></td><td>1</td><td></td><td>1</td><td> Image: A set of the set of the</td><td>BSPT (* insert thread size e.g. BK = 1/2")</td></tr> <tr><td>Image: constraint of the constr</td><td>1</td><td> Image: A set of the set of the</td><td>~</td><td></td><td>1</td><td></td><td>1</td><td> ✓ </td><td>BSPP (* insert thread size e.g. 8R = 1/2")</td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$DIN 19213 instrument seal grooves$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Lockable 'T' Bar$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Anti tamper spindle$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Anti tamper spindle$\checkmark$<td></td><td></td><td></td><td> Image: A start of the start of</td><td>1</td><td></td><td>1</td><td></td><td>Inverted connections A-LOK/CPI</td></td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$DIN 19213 instrument seal grooves$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Lockable 'T' Bar$\checkmark$</td><td>1</td><td> Image: A set of the set of the</td><td>~</td><td></td><td>1</td><td></td><td>1</td><td> ✓ </td><td>PTFree connect (see page 22)</td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Anti tamper spindle$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Anti tamper spindle + key$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Handwheel$\checkmark$<td< td=""><td>1</td><td> Image: A set of the set of the</td><td> Image: A set of the set of the</td><td>1</td><td>1</td><td></td><td></td><td></td><td></td></td<></td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\land$</td><td>$\checkmark$</td><td> Image: A set of the set of the</td><td> Image: A set of the set of the</td><td> Image: A set of the set of the</td><td>1</td><td>1</td><td>1</td><td> Image: A second s</td><td>Lockable 'T' Bar</td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\land$</td><td>$\checkmark$</td><td> Image: A set of the set of the</td><td> Image: A set of the set of the</td><td> Image: A second s</td><td>1</td><td>1</td><td>1</td><td> Image: A set of the set of the</td><td>Anti tamper spindle</td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Handwheel$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Lockable handwheel$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Assembled to bracket$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Assembled to bracket$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Assembled to bracket$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Assembled to bracket$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Assembled to bracket$\checkmark$<td>$\checkmark$</td><td> Image: A start of the start of</td><td> Image: A set of the set of the</td><td> Image: A second s</td><td>1</td><td>1</td><td>1</td><td> Image: A second s</td><td></td></td></tr> <tr><td>$\begin{array}{c c c c c c c c c c c c c c c c c c c$</td><td>$\checkmark$</td><td> Image: A start of the start of</td><td> Image: A set of the set of the</td><td> Image: A second s</td><td>1</td><td>1</td><td>1</td><td> Image: A second s</td><td></td></tr> <tr><td>$\begin{array}{c c c c c c c c c c c c c c c c c c c$</td><td>$\checkmark$</td><td> Image: A start of the start of</td><td> Image: A set of the set of the</td><td> Image: A second s</td><td>1</td><td>1</td><td>1</td><td> Image: A second s</td><td>Lockable handwheel</td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$56mm centres$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$57mm centres$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$<math>Stainless steel mounting bolts 7/16 UNF$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$M10 \times 1.5$ C.S. mounting bolts$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$M10 \times 1.5$ stainless steel mounting bolts$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$M10 \times 1.5$ stainless steel mounting bolts$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$M10 \times 1.5$ stainless steel mounting bolts$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$M10 \times 1.5$ stainless steel mounting bolts$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\land$$\checkmark$$\checkmark$$\checkmark$$\land$$\land$$\land$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\land$$\land$$\land$$\checkmark$<t< math=""></t<></math></td><td>\checkmark</td><td> Image: A start of the start of</td><td> Image: A start of the start of</td><td> Image: A second s</td><td>1</td><td>1</td><td>1</td><td> Image: A second s</td><td>Assembled to bracket</td></tr> <tr><td>$\begin{array}{c c c c c c c c c c c c c c c c c c c$</td><td>$\checkmark$</td><td></td><td></td><td>1</td><td>1</td><td>1</td><td>1</td><td></td><td></td></tr> <tr><td>$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$Stainless steel mounting bolts 7/16 UNF$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$M10 x 1.5 C.S. mounting bolts$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$$\checkmark$M10 x 1.5 trainless steel mounting bolts\checkmark<td>1</td><td></td><td></td><td></td><td></td><td>1</td><td></td><td></td><td></td></td></tr> <tr><td>$\begin{array}{c c c c c c c c c c c c c c c c c c c$</td><td></td><td></td><td>1</td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>$\begin{array}{c c c c c c c c c c c c c c c c c c c$</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>$\begin{array}{c c c c c c c c c c c c c c c c c c c$</td><td></td><td></td><td></td><td>-</td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td>_</td><td></td><td>-</td><td>-</td><td>-</td><td>1</td><td></td><td> ✓ </td><td></td></tr> <tr><td>Image: square Image: square Imag</td><td></td><td></td><td>-</td><td>-</td><td></td><td>1</td><td>-</td><td></td><td></td></tr> <tr><td>\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Heat code trace certificates</td><td>_</td><td></td><td></td><td></td><td></td><td>1</td><td></td><td></td><td></td></tr> <tr><td></td><td>_</td><td></td><td></td><td></td><td></td><td>1</td><td></td><td></td><td></td></tr> <tr><td>\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Test certificates</td><td></td><td><i>✓</i></td><td><i>\</i></td><td><i>\</i></td><td>1</td><td>1</td><td><i>\</i></td><td><i></i></td><td>Test certificates</td></tr> <tr><td>\checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Air testing</td><td></td><td></td><td></td><td></td><td></td><td>1</td><td></td><td>1 1</td><td></td></tr> | Image: A set of the set of the | | | | | 1 | 1 | | | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Butt weld (* insert pipe size) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BK = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark Inverted connections A-LOK/CPI \checkmark < | Image: A second s | ✓ | Image: A start of the start of | Image: A second s | 1 | 1 | 1 | \checkmark | | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BK = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. 8R = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark | \checkmark | \checkmark | \checkmark | | 1 | | \checkmark | \checkmark | Socket weld (* insert pipe size) | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. $8R = 1/2")$ \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark PTFree connect (see page 22) \checkmark <t< td=""><td>\checkmark</td><td>\checkmark</td><td>\checkmark</td><td></td><td>\checkmark</td><td></td><td>\checkmark</td><td>\checkmark</td><td>Butt weld (* insert pipe size)</td></t<> | \checkmark | \checkmark | \checkmark | | \checkmark | | \checkmark | \checkmark | Butt weld (* insert pipe size) | Image: Second constraint of the second constrant of the second constraint of the second co | Image: A set of the set of the | < | < | | 1 | | 1 | Image: A set of the set of the | BSPT (* insert thread size e.g. BK = 1/2") | Image: constraint of the constr | 1 | Image: A set of the set of the | ~ | | 1 | | 1 | ✓ | BSPP (* insert thread size e.g. 8R = 1/2") | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark DIN 19213 instrument seal grooves \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable 'T' Bar \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark <td></td> <td></td> <td></td> <td> Image: A start of the start of</td> <td>1</td> <td></td> <td>1</td> <td></td> <td>Inverted connections A-LOK/CPI</td> | | | | Image: A start of the start of | 1 | | 1 | | Inverted connections A-LOK/CPI | \checkmark \checkmark \checkmark \checkmark \checkmark DIN 19213 instrument seal grooves \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable 'T' Bar \checkmark | 1 | Image: A set of the set of the | ~ | | 1 | | 1 | ✓ | PTFree connect (see page 22) | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle + key \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Handwheel \checkmark <td< td=""><td>1</td><td> Image: A set of the set of the</td><td> Image: A set of the set of the</td><td>1</td><td>1</td><td></td><td></td><td></td><td></td></td<> | 1 | Image: A set of the set of the | Image: A set of the set of the | 1 | 1 | | | | | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \land | \checkmark | Image: A set of the set of the | Image: A set of the set of the | Image: A set of the set of the | 1 | 1 | 1 | Image: A second s | Lockable 'T' Bar | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \land | \checkmark | Image: A set of the set of the | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A set of the set of the | Anti tamper spindle | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Handwheel \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable handwheel \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark <td>\checkmark</td> <td> Image: A start of the start of</td> <td> Image: A set of the set of the</td> <td> Image: A second s</td> <td>1</td> <td>1</td> <td>1</td> <td> Image: A second s</td> <td></td> | \checkmark | Image: A start of the start of | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A second s | | $ \begin{array}{c c c c c c c c c c c c c c c c c c c $ | \checkmark | Image: A start of the start of | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A second s | | $ \begin{array}{c c c c c c c c c c c c c c c c c c c $ | \checkmark | Image: A start of the start of | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A second s | Lockable handwheel | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $56mm centres$ \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $57mm centres$ \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $Stainless steel mounting bolts 7/16 UNF\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 C.S. mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\land\checkmark\checkmark\checkmark\land\land\land\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\land\land\land\checkmark$ | \checkmark | Image: A start of the start of | Image: A start of the start of | Image: A second s | 1 | 1 | 1 | Image: A second s | Assembled to bracket | $ \begin{array}{c c c c c c c c c c c c c c c c c c c $ | \checkmark | | | 1 | 1 | 1 | 1 | | | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Stainless steel mounting bolts 7/16 UNF \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 C.S. mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark <td>1</td> <td></td> <td></td> <td></td> <td></td> <td>1</td> <td></td> <td></td> <td></td> | 1 | | | | | 1 | | | | $ \begin{array}{c c c c c c c c c c c c c c c c c c c $ | | | 1 | | | | | | | $ \begin{array}{c c c c c c c c c c c c c c c c c c c $ | | | | | | | | | | $ \begin{array}{c c c c c c c c c c c c c c c c c c c $ | | | | - | | | | | | | _ | | - | - | - | 1 | | ✓ | | Image: square Imag | | | - | - | | 1 | - | | | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Heat code trace certificates | _ | | | | | 1 | | | | | _ | | | | | 1 | | | | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Test certificates | | <i>✓</i> | <i>\</i> | <i>\</i> | 1 | 1 | <i>\</i> | <i></i> | Test certificates | \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Air testing | | | | | | 1 | | 1 1 | |
| Image: A set of the set of the

 |
 | | | | 1 | 1 | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Butt weld (* insert pipe size) \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BK = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. BR = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark Inverted connections A-LOK/CPI \checkmark <

 | Image: A second s | ✓
 | Image: A start of the start of | Image: A second s | 1 | 1 | 1 | \checkmark | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | |
 | | |
 | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPT (* insert thread size e.g. BK = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. 8R = 1/2") \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark

 | \checkmark
 | \checkmark | \checkmark | | 1 | | \checkmark | \checkmark | Socket weld (* insert pipe size) | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark BSPP (* insert thread size e.g. $8R = 1/2")$ \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Inverted connections A-LOK/CPI \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark PTFree connect (see page 22) \checkmark <t< td=""><td>\checkmark</td><td>\checkmark</td><td>\checkmark</td><td></td><td>\checkmark</td><td></td><td>\checkmark</td><td>\checkmark</td><td>Butt weld (* insert pipe size)</td></t<>

 | \checkmark
 | \checkmark | \checkmark | | \checkmark | | \checkmark | \checkmark | Butt weld (* insert pipe size) | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Image: Second constraint of the second constrant of the second constraint of the second co

 | Image: A set of the set of the | <
 | < | | 1 | | 1 | Image: A set of the set of the | BSPT (* insert thread size e.g. BK = 1/2") | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | |
 | | |
 | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Image: constraint of the constr

 | 1
 | Image: A set of the set of the | ~ | | 1 | | 1 | ✓ | BSPP (* insert thread size e.g. 8R = 1/2") | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | |
 | | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark DIN 19213 instrument seal grooves \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable 'T' Bar \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark <td></td> <td></td> <td></td> <td> Image: A start of the start of</td> <td>1</td> <td></td> <td>1</td> <td></td> <td>Inverted connections A-LOK/CPI</td>

 | |
 | | Image: A start of the start of | 1 | | 1 | | Inverted connections A-LOK/CPI | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | |
 | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark DIN 19213 instrument seal grooves \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable 'T' Bar \checkmark

 | 1
 | Image: A set of the set of the | ~ | | 1 | | 1 | ✓ | PTFree connect (see page 22) | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | | | | | | | | | | |
 | | | | | | | | | | | |

 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Anti tamper spindle + key \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Handwheel \checkmark <td< td=""><td>1</td><td> Image: A set of the set of the</td><td> Image: A set of the set of the</td><td>1</td><td>1</td><td></td><td></td><td></td><td></td></td<>

 | 1 | Image: A set of the set of the | Image: A set of the set of the | 1 | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | |
 | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \land

 | \checkmark
 | Image: A set of the set of the | Image: A set of the set of the | Image: A set of the set of the | 1 | 1 | 1 | Image: A second s | Lockable 'T' Bar | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | |
 | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \land

 | \checkmark
 | Image: A set of the set of the | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A set of the set of the | Anti tamper spindle | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | |
 | | | | | | | | | | |
 | | | | | |
 | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Handwheel \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Lockable handwheel \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Assembled to bracket \checkmark <td>\checkmark</td> <td> Image: A start of the start of</td> <td> Image: A set of the set of the</td> <td> Image: A second s</td> <td>1</td> <td>1</td> <td>1</td> <td> Image: A second s</td> <td></td>

 | \checkmark | Image: A start of the start of | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A second s | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | |
 | | |
 | | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| $ \begin{array}{c c c c c c c c c c c c c c c c c c c $

 | \checkmark | Image: A start of the start of | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A second s | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | |
 | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| $ \begin{array}{c c c c c c c c c c c c c c c c c c c $

 | \checkmark | Image: A start of the start of | Image: A set of the set of the | Image: A second s | 1 | 1 | 1 | Image: A second s | Lockable handwheel | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | |
 | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $56mm centres$ \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $57mm centres$ \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark $Stainless steel mounting bolts 7/16 UNF\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 C.S. mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmarkM10 \times 1.5 stainless steel mounting bolts\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\land\checkmark\checkmark\checkmark\land\land\land\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\checkmark\land\land\land\checkmark$

 | \checkmark | Image: A start of the start of | Image: A start of the start of | Image: A second s | 1 | 1 | 1 | Image: A second s | Assembled to bracket | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | |
 | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| $ \begin{array}{c c c c c c c c c c c c c c c c c c c $

 | \checkmark | | | 1 | 1 | 1 | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Stainless steel mounting bolts 7/16 UNF \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 C.S. mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark M10 x 1.5 trainless steel mounting bolts \checkmark <td>1</td> <td></td> <td></td> <td></td> <td></td> <td>1</td> <td></td> <td></td> <td></td>

 | 1
 | | | | | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| $ \begin{array}{c c c c c c c c c c c c c c c c c c c $

 | | | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| $ \begin{array}{c c c c c c c c c c c c c c c c c c c $

 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| $ \begin{array}{c c c c c c c c c c c c c c c c c c c $

 | | | | - | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|

 | _ | | - | - | - | 1 | | ✓
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Image: square Imag

 |
 | | - | - | | 1 | - | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Heat code trace certificates

 | _ | | | | | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|

 | _ | | | | | 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Test certificates

 | | <i>✓</i> | <i>\</i> | <i>\</i> | 1 | 1 | <i>\</i> | <i></i>
 | Test certificates | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark \checkmark Air testing

 | | | | | | 1 | | 1 1
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | |
 | | | | | |
 | | | | | | | |
 | | | | | | | | | |
 | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | |
 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

Accessories and spares	Description	Part number	Box quantity
	PTFE manifold/instrument seals	HPTFESEAL/10	10
*Insert 9 PCTFE seat	Graphite manifold/instrument seals	HGRAPHSEAL/10	10
*Insert PK PEEK seat	Isolate valve with PTFE gland, metal seat	HBNTS*ISPTFE/3	3
	Drain/bleed valve with PTFE gland, metal seat	HBNTS*DRPTFE/3	3
	Equalize valve with PTFE gland, metal seat	HBNTS*EQPTFE/3	3
	Isolate valve with graphoil gland, metal seat	HBNTSISGRAP/3	3
	Drain/bleed valve with graphoil gland, metal seat	HBNTSDRGRAP/3	3
	Equalize valve with graphoil gland, metal seat	HBNTSEQGRAP/3	3

27

Search

Parker Hannifin Corporation

Web Site

³⁻D Drawings

TECHNOLOGY, APPLIED





Parker Hannifin plc

Instrumentation Products Division Riverside Road Pottington Business Park Barnstaple, Devon EX31 1NP England Tel: +44 (0)1271 313131 Fax: +44 (0)1271 373636



Parker Hannifin Corp.

Instrumentation Valve Division 2651 Alabama Hwy 21 N Jacksonville, AL36265 U.S.A Tel: (256) 435 2130 Fax: (256) 435 7718

Parker Instrumentation Sales & Service Locations

Visit www.parker.com

Europe - Call free of charge 00800 27 27 5374 **U.S.** - Call toll free 1-800-272-7537 (1-800-C-Parker)

Sales Offices

Africa (27) (11) 392 7280 Argentina (58) (11) 4752 4169 Australia (61) (2) 9634 7777 Azerbaijan (99) (412) 983 966 Brazil (55) (12) 3545100 Canada (905) 945-2274 China (86) (21) 6445 9339 Egypt (2) 025194018 Finland (358) 9476 731 France (33) 141 115390 Germany (49) 6134 204 243 (852) 2428 8008 Hong Kong India (91) (22) 5771671 Italy (39) (2) 451921 Japan (81) (3) 6408 3900 Korea (82) (2) 598 0414 Latin American/ Caribbean Countries (305) 470-8800 (47) (51) 826300 Norway Singapore (65) 261 52 33 Sweden (46) 157434900 (886) (2) 8787 3780 Taiwan United Arab Emirates (971) (2) 6788587 United Kingdom (44) 1271 313131 Venezuela (58) (2) 2385422



Visit us on the web at www.parker.com/ipd

Search

Web Site